

**WASTEWATER
C-400 TO C-417**

COVER - TOP VIEW
SANITARY SEWER




CAST 1"
 DIA. HOLE


COVER - TOP VIEW
STORM SEWER



NOTE:

1. FRAME AND COVER SHALL CONFORM TO MAG. STD. DETAIL 423, 424, OR 425.
2. DELETE BEADS ON MAG. STD. DETAIL WHICH CONFLICT WITH LOGO SHOWN.
3. LETTERING ON MANHOLE COVER SHALL CONTAIN UTILITY FOR WHICH MANHOLE IS NEEDED, ("CHANDLER SANITARY SEWER" OR, "CHANDLER STORM SEWER"), OR AS DIRECTED.
4. THE TOTAL WIDTH OF INDIVIDUAL LETTERS SHALL BE SUCH THAT LETTERS AND WORDS ARE EQUALLY SPACED AND SHALL BE BALANCED TO FORM A COMPLETE CIRCLE WITH SPACES BEFORE AND AFTER THE WORD.
5. LETTERS SHALL BE 2" IN HEIGHT AND RAISED 1/8" ABOVE LEVEL OF COVER.
6. TYPE OF LETTERS SHALL BE SUBMITTED FOR APPROVAL.

DETAIL NO. C-400	 CITY OF CHANDLER STANDARD DETAIL	MANHOLE COVER	APPROVED:  CITY ENGINEER DATE: <u>01/08/09</u>	DETAIL NO. C-400
----------------------------	---	----------------------	---	----------------------------

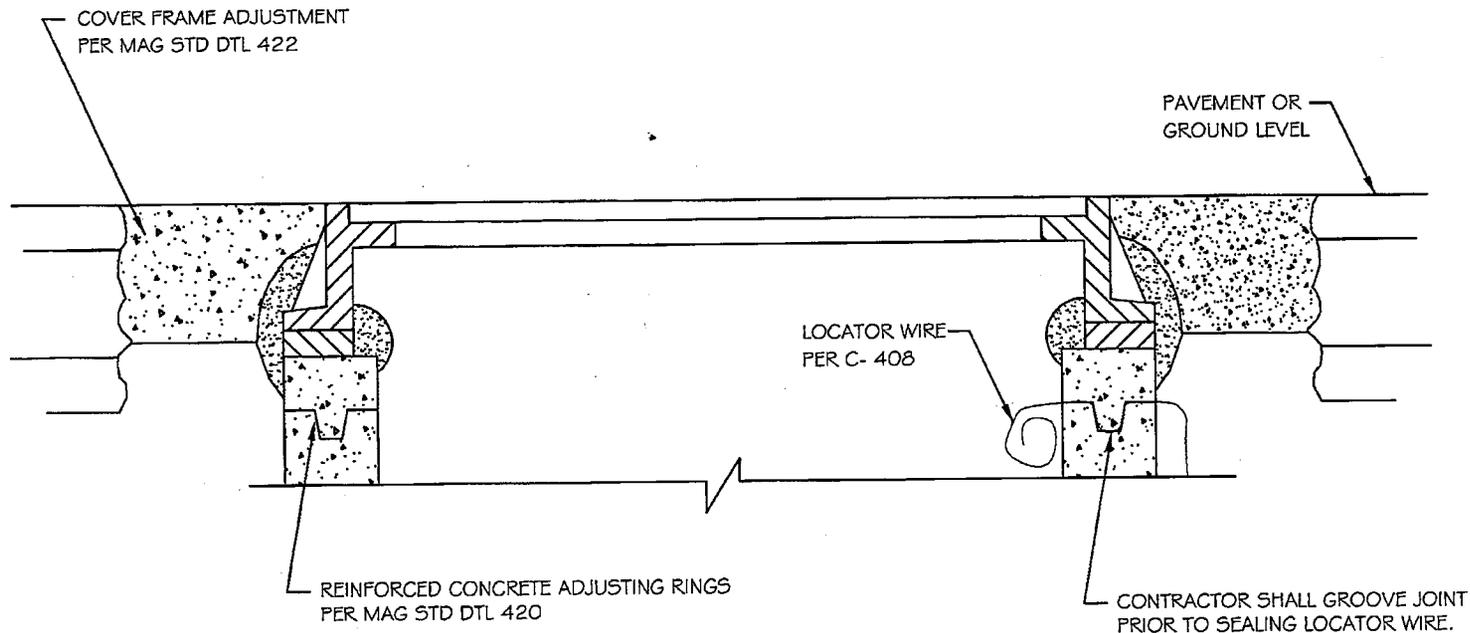

DETAIL NO.
C-401
 NTS




CITY OF
 CHANDLER
 STANDARD
 DETAIL

**MANHOLE
 CONCRETE COLLAR DETAIL**

APPROVED: *Jim Hill*
 CITY ENGINEER
 DATE: 01/08/09

DETAIL NO.
C-401
 NTS

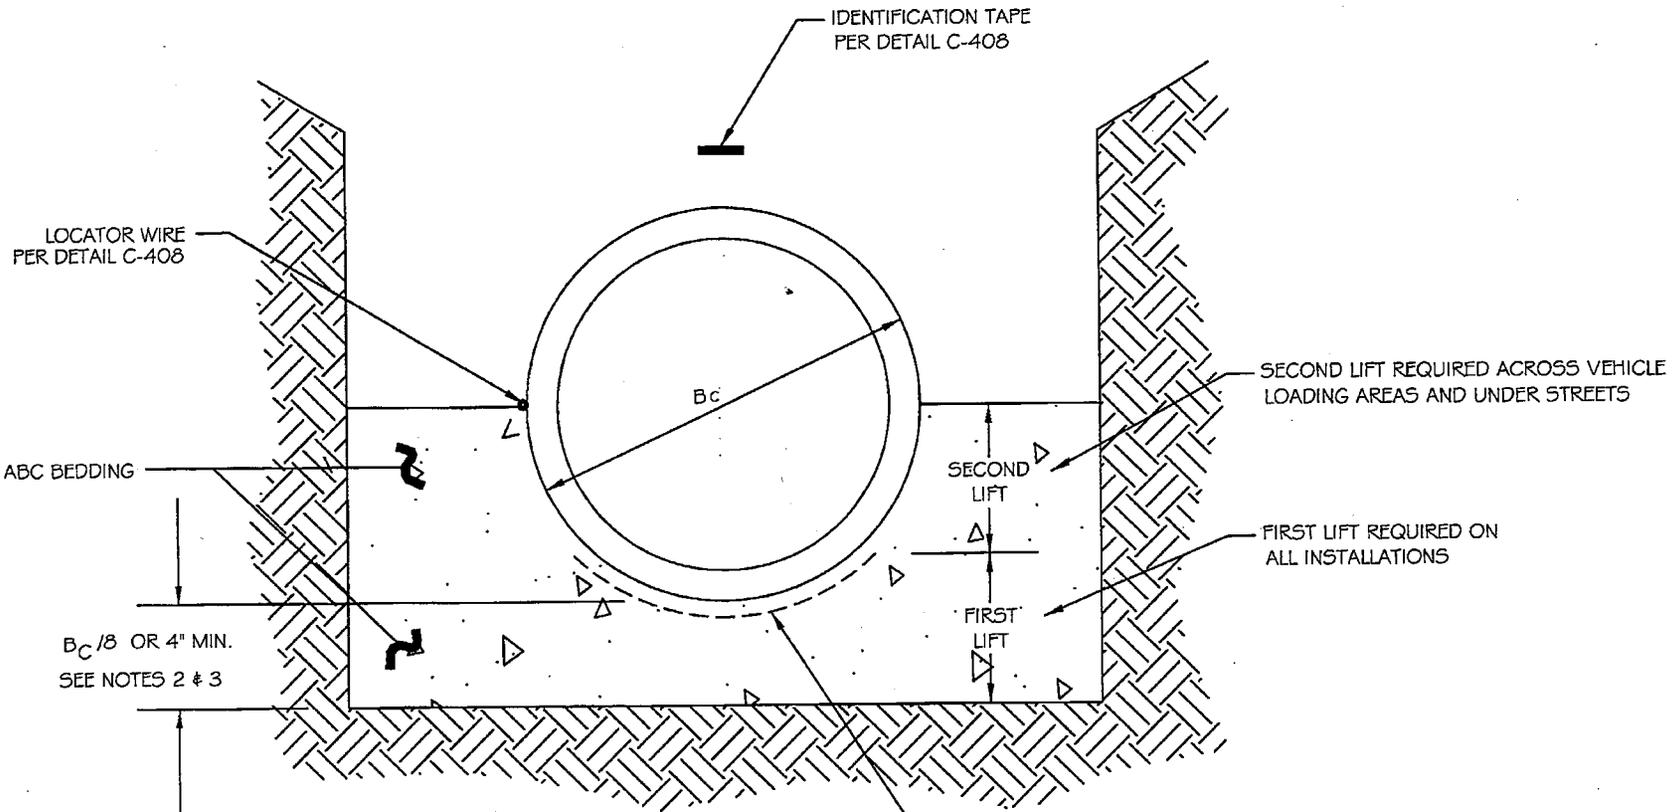

NOTES:

1. TRENCH WIDTH IN ACCORDANCE WITH MAG STD. TABLE 601-1.
2. MINIMUM 4" FOR PIPES 12" OR SMALLER.
3. MINIMUM 6" FOR PIPES LARGER THAN 12".
4. SEWER PIPE SHALL BE EXTRA-STRENGTH VITRIFIED CLAY PIPE PER MAG SPEC 743. PVC PER MAG SPEC 745 IS PERMITTED AT DEPTHS OF COVER LESS THAN 10'. SOILS INVESTIGATION, TRENCH DETAIL, STRUCTURAL ANALYSIS, AND CITY ENGINEER'S APPROVAL IS REQUIRED FOR PERMITTING PVC PIPE AT GREATER THAN 10' COVER.

DETAIL NO. C-402 NTS	 CITY OF CHANDLER STANDARD DETAIL	SEWER PIPE BEDDING DETAIL	APPROVED: <i>[Signature]</i> CITY ENGINEER DATE: <u>01/08/09</u>	DETAIL NO. C-402 NTS
-----------------------------------	--	----------------------------------	--	-----------------------------------

RECLAIMED WATER SERVICE CONNECTIONS SIZING TABLE

SERVICE CONNECTION FLOW RATE (GPM)	IRRIGATION SERVICE LINE SIZE (AFTER PUMP)	RECLAIMED WATER SERVICE CONNECTION LINE SIZE (FROM MAIN TO PUMP)	WET WELL PUMP SEE PAGES:	CAN PUMP SEE PAGES:
UP TO 80	2"	4"	PAGE 3	-
80 TO 70	3"	4"	PAGE 4	-
170 TO 300	4"	6"	PAGES 5 & 6	PAGES 9 & 10
300 TO 700	6"	8"	PAGES 7 & 8	PAGES 11 & 12

NOTES:

1. THE DATA FORM ON DETAIL C-404 PAGE 2 MUST BE COMPLETED AND SUBMITTED WITH THE BUILDING PERMIT APPLICATION FOR THE INLINE PUMP AND CAN PUMP SERVICE CONNECTIONS.
2. THESE RECLAIMED WATER SERVICE CONNECTION DETAILS PRESENT THE MINIMUM REQUIREMENTS TO ENSURE THE INTEGRITY OF THE CITY OF CHANDLER'S RECLAIMED WATER DISTRIBUTION SYSTEM. ALL RECLAIMED WATER SERVICE CONNECTIONS MUST BE DESIGNED IN ACCORDANCE WITH THESE DETAILS AND THE SITE-SPECIFIC REQUIREMENTS INCLUDING: THE GROUND ELEVATION, IRRIGATION SYSTEM FLOW REQUIREMENTS, AND IRRIGATION SYSTEM PRESSURE REQUIREMENTS.
3. ALL RECLAIMED WATER SERVICE CONNECTIONS SHALL BE DESIGNED IN ACCORDANCE WITH MARICOPA COUNTY ENVIRONMENTAL SERVICES DEPARTMENT (MCESD) AND ARIZONA DEPARTMENT OF ENVIRONMENTAL QUALITY (ADEQ) REQUIREMENTS.
4. AN APPROVAL TO CONSTRUCT PERMIT FROM MCESD IS REQUIRED FOR ALL RECLAIMED WATER SERVICE CONNECTIONS PRIOR TO CONSTRUCTION. A COPY OF THE APPROVAL OF CONSTRUCTION FROM MCDES MUST BE SUBMITTED TO THE CITY OF CHANDLER PRIOR TO PLACING THE RECLAIMED WATER SERVICE CONNECTION IN SERVICE.
5. ALL ABOVE GROUND PIPING SHALL BE PAINTED PURPLE OR STENCILED IN ACCORDANCE WITH MARICOPA ASSOCIATION OF GOVERNMENTS (MAG) STANDARDS SECTION 616.4.2.

DEVELOPER: _____

TURNOUT ADDRESS: _____

FLOW RATE CRITERIA

ANNUAL AVERAGE _____ ACRE FT/YEAR

MAXIMUM MONTH _____ ACRE FT

INSTANTANEOUS _____ GPM

SUCTION HEAD CALCULATION

① LENGTH AND DIAMETER OF PIPING FROM NEAREST RECLAIMED WATER TRANSMISSION MAIN (RWTM) TO TURNOUT _____

② FRICTION LOSSES IN PIPING FROM RWTM TO TURNOUT AT INSTANTANEOUS FLOW RATE _____ FEET

③ HGL IN RWTM 1330 TO 1345 FEET

④ HGL AT TURNOUT (HGL OF RWTM LESS FRICTION LOSSES CALCULATED ABOVE) _____ TO _____ FEET

⑤ ELEVATION AT TURNOUT _____ FEET

⑥ SUCTION PRESSURE AT TURNOUT _____ TO _____ PSI

⑦ PUMP TDH _____ FEET

⑧ DISCHARGE PRESSURE _____ PSI

DETAIL NO.
C-404
PAGE 2 OF 14




CITY OF
CHANDLER
STANDARD
DETAIL

**RECLAIMED WATER SERVICE
CONNECTION DATA FORM**

APPROVED: *[Signature]*
CITY ENGINEER
DATE: June 12/08


DETAIL NO.
C-404
PAGE 2 OF 12

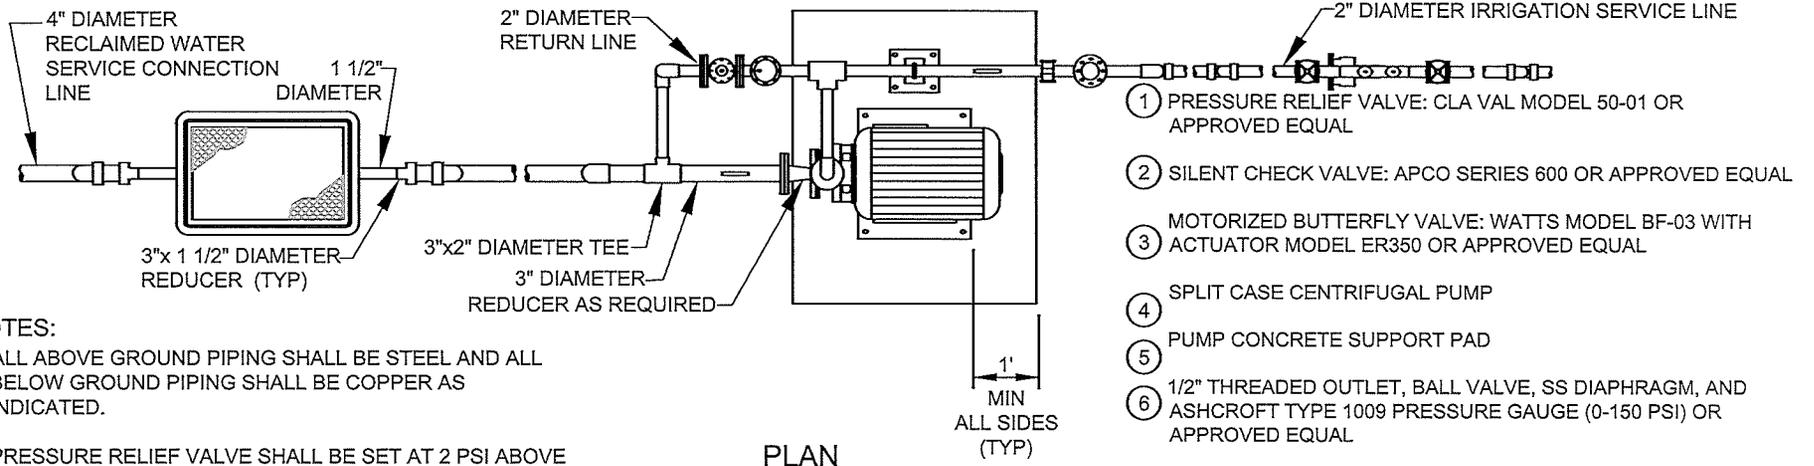


NOTES:

1. ALL ABOVE GROUND PIPING SHALL BE STEEL AND ALL BELOW GROUND PIPING SHALL BE COPPER AS INDICATED.
2. PRESSURE RELIEF VALVE SHALL BE SET AT 2 PSI ABOVE SPRINKLER DESIGN PRESSURE.
3. DEVELOPER SHALL PROVIDE UTILITY SERVICES TO THE FACILITY AS REQUIRED.
4. DEVELOPER MAY USE VARIABLE FREQUENCY DRIVE WITH PUMP IN LIEU OF RETURN LINE.
5. DEVELOPER SHALL INTERLOCK MOTORIZED BUTTERFLY VALVE TO OPEN/CLOSE ON PUMP START/STOP.

1 1/2" DIAMETER RECLAIMED WATER METER AND BOX PER COC STANDARD DETAIL NO. C-301

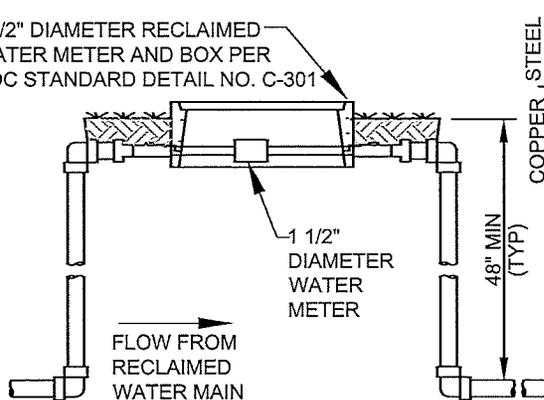

PLAN

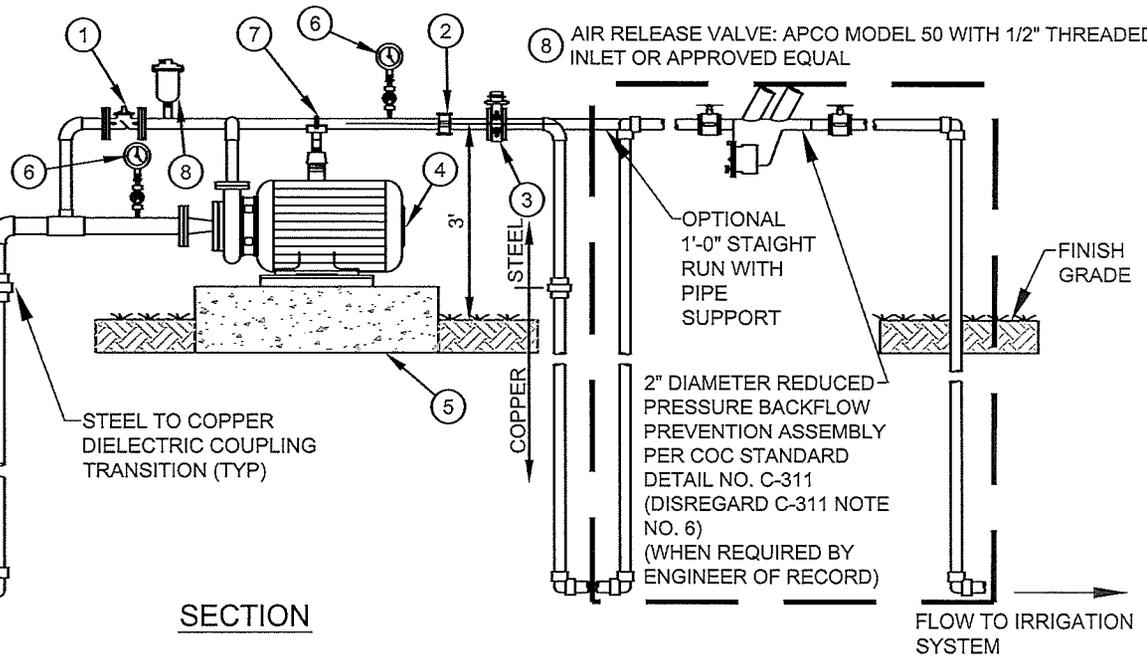

SECTION

DETAIL NO.
C-404
PAGE 3 OF 12




CITY OF CHANDLER
STANDARD DETAIL

**2" RECLAIMED WATER
IRRIGATION SERVICE LINE
INLINE PUMP TYPE**

APPROVED: *[Signature]*
CITY ENGINEER
DATE: 1-14-16



DETAIL NO.
C-404
PAGE 3 OF 12

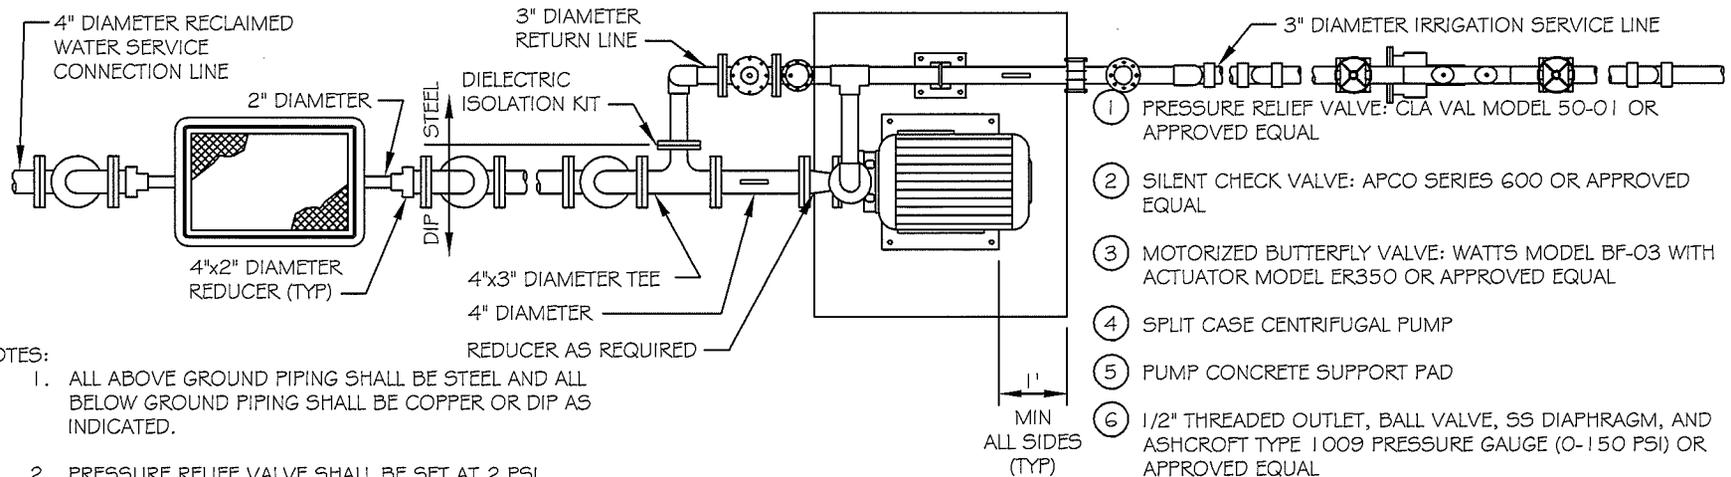

NOTES:

1. ALL ABOVE GROUND PIPING SHALL BE STEEL AND ALL BELOW GROUND PIPING SHALL BE COPPER OR DIP AS INDICATED.
2. PRESSURE RELIEF VALVE SHALL BE SET AT 2 PSI ABOVE SPRINKLER DESIGN PRESSURE.
3. DEVELOPER SHALL PROVIDE UTILITY POWER TO THE FACILITY AS REQUIRED.
4. DEVELOPER MAY USE VARIABLE FREQUENCY DRIVE WITH PUMP IN LIEU OF RETURN LINE.
5. DEVELOPER SHALL INTERLOCK MOTORIZED BUTTERFLY VALVE TO OPEN/CLOSE ON PUMP START/STOP.

PLAN

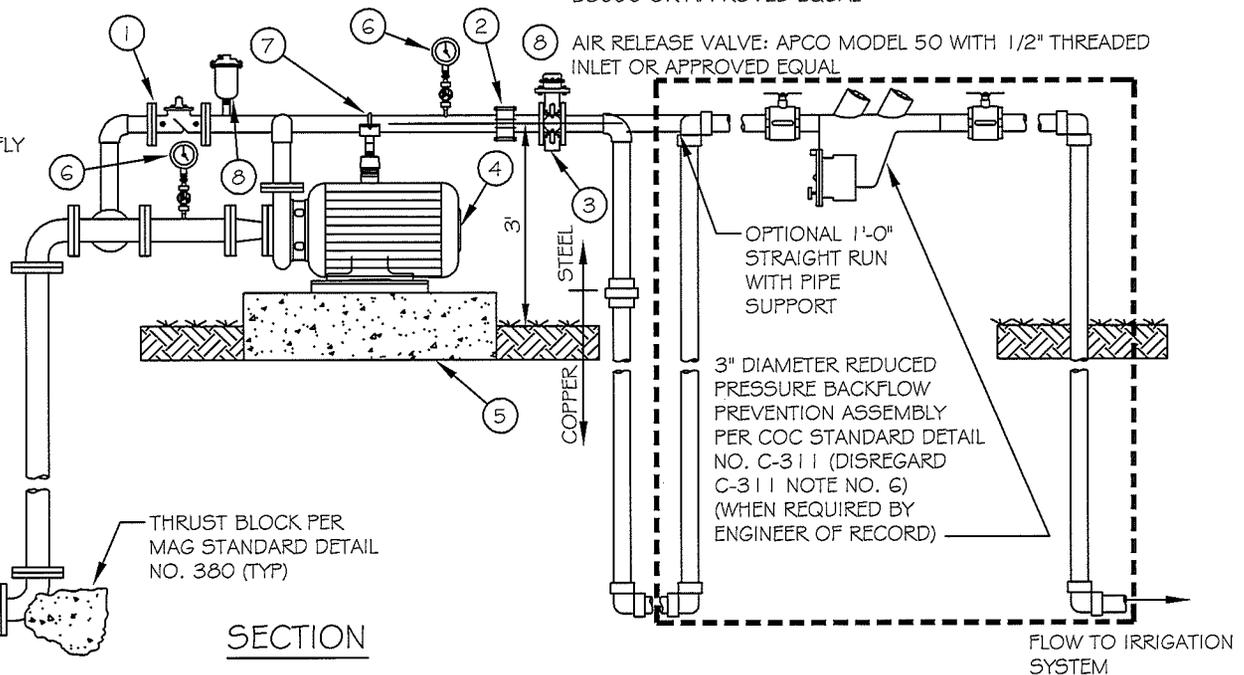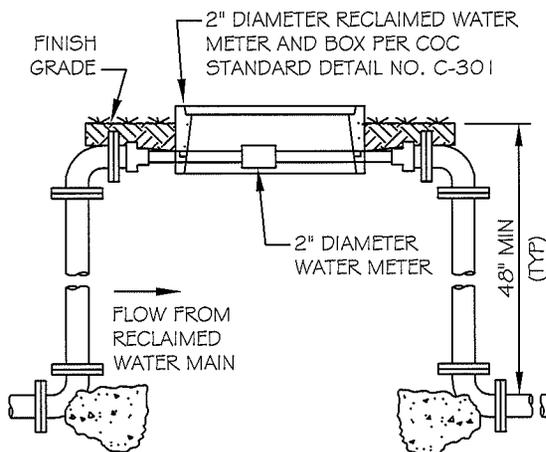

SECTION




**3" RECLAIMED WATER
IRRIGATION SERVICE LINE
INLINE PUMP TYPE**

APPROVED:

DATE:

Daniel Cole
CITY ENGINEER

1-9-14

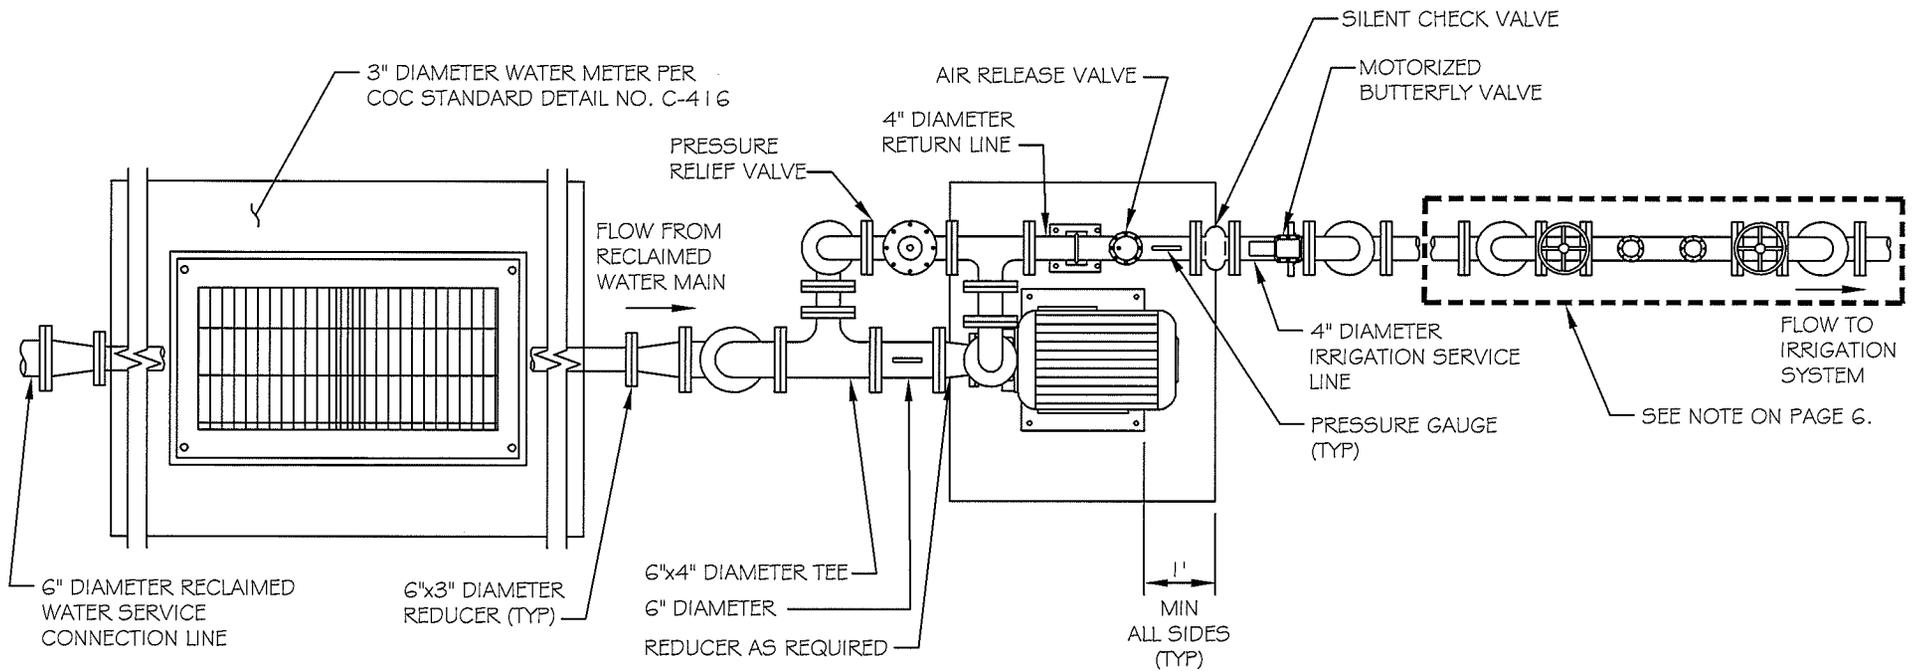


PLAN

NOTES:

1. ALL PIPING SHALL BE DUCTILE IRON (DIP) AS SHOWN.
2. PRESSURE RELIEF VALVE SHALL BE SET AT 2 PSI ABOVE SPRINKLER DESIGN PRESSURE.
3. DEVELOPER SHALL PROVIDE UTILITY SERVICES TO THE FACILITY AS REQUIRED.
4. DEVELOPER MAY USE VARIABLE FREQUENCY DRIVE WITH PUMP IN LIEU OF RETURN LINE.
5. DEVELOPER SHALL INTERLOCK MOTORIZED BUTTERFLY VALVE TO OPEN/CLOSE ON PUMP START/STOP.

DETAIL NO.
C-404
PAGE 5 OF 12

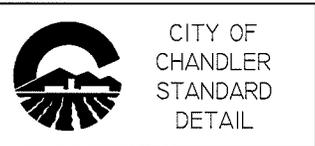

**4" RECLAIMED WATER
IRRIGATION SERVICE LINE
INLINE PUMP TYPE**


APPROVED: *David W. Cook*
CITY ENGINEER
DATE: 1-9-14

DETAIL NO.
C-404
PAGE 5 OF 12

- ① PRESSURE RELIEF VALVE: CLA VAL MODEL 50-01 OR APPROVED EQUAL
- ② SILENT CHECK VALVE: APCO SERIES 600 OR APPROVED EQUAL
- ③ MOTORIZED BUTTERFLY VALVE: MUELLER LINE SEAL III OR APPROVED EQUAL
- ④ SPLIT CASE CENTRIFUGAL PUMP
- ⑤ PUMP CONCRETE SUPPORT PAD
- ⑥ 1/2" THREADED OUTLET, BALL VALVE, SS DIAPHRAGM, AND ASHCROFT TYPE 1 009 PRESSURE GAUGE (0-150 PSI) OR APPROVED EQUAL
- ⑦ PIPE SUPPORT: B-LINE FIGURE B3088T, B3089, AND B3090 OR APPROVED EQUAL

- ⑧ AIR RELEASE VALVE: APCO MODEL 50 WITH 1" THREADED INLET OR APPROVED EQUAL

4" DIAMETER REDUCED PRESSURE BACKFLOW PREVENTION ASSEMBLY PER COC STANDARD DETAIL NO. C-315 (WHEN REQUIRED BY ENGINEER OF RECORD)

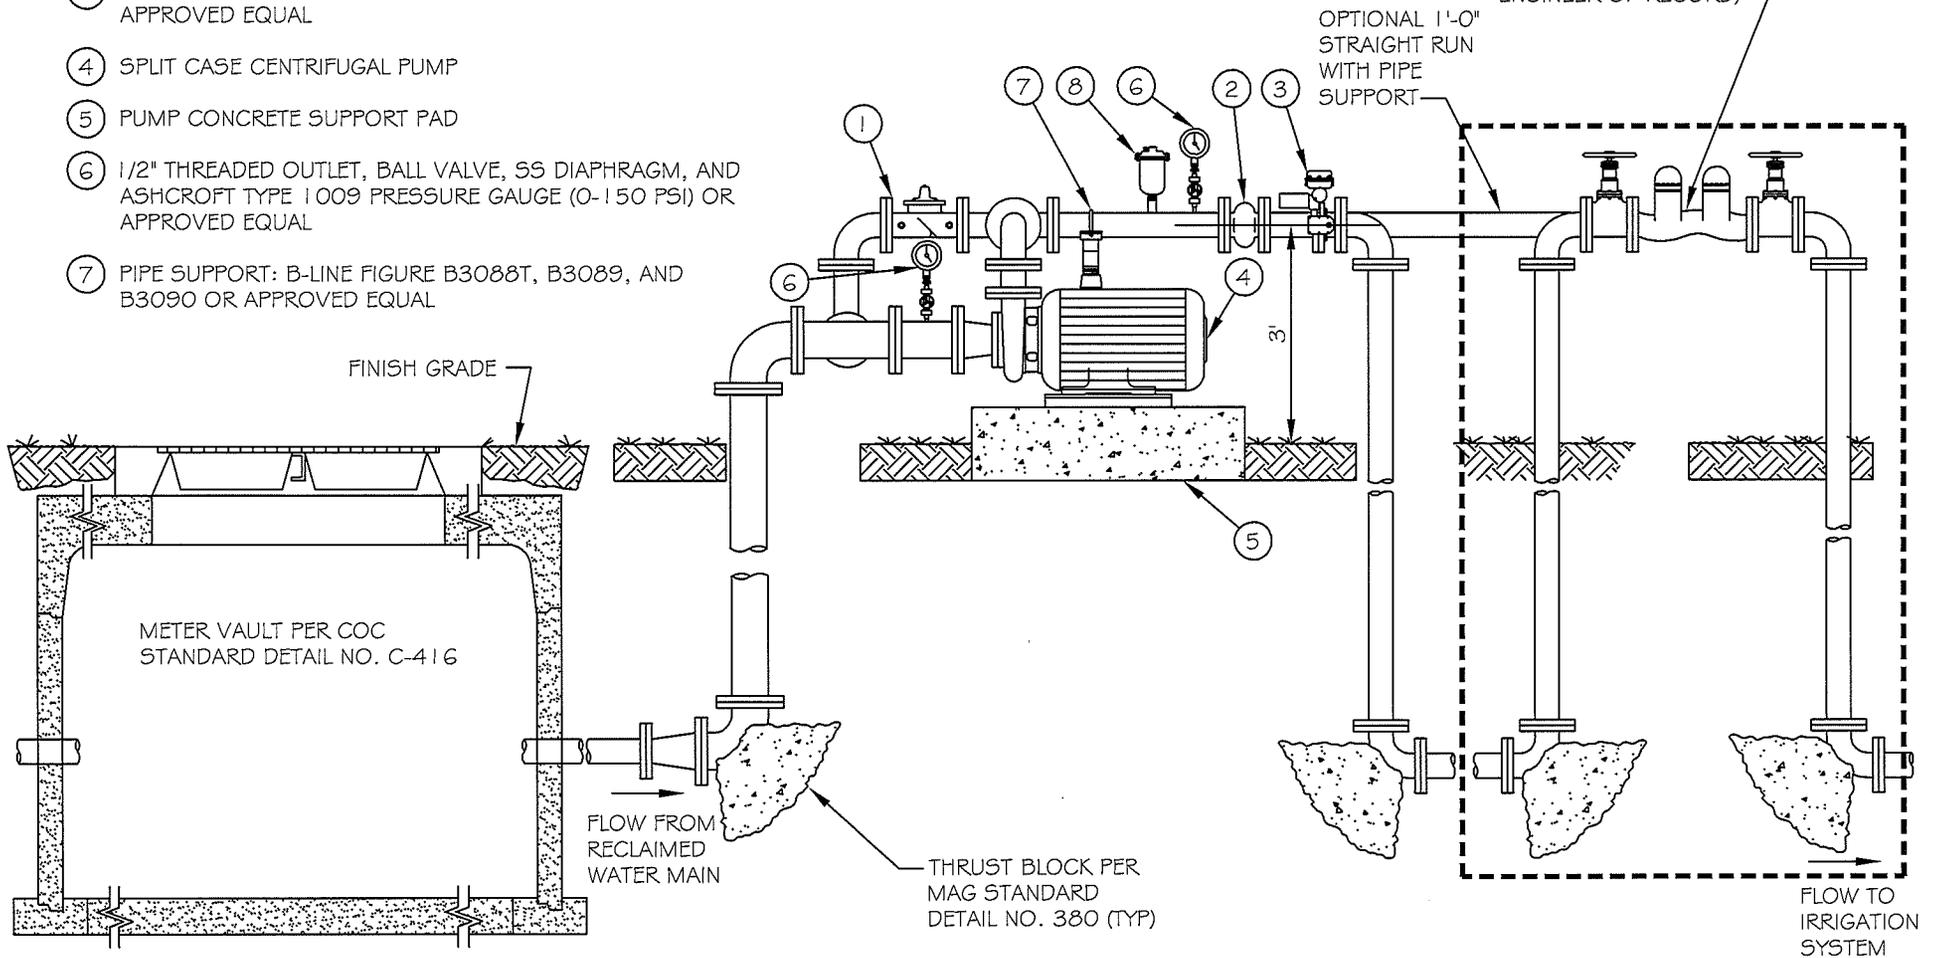


SECTION



**4" RECLAIMED WATER
IRRIGATION SERVICE LINE
INLINE PUMP TYPE**

APPROVED: *David W. Work*
CITY ENGINEER
DATE: 1-9-14

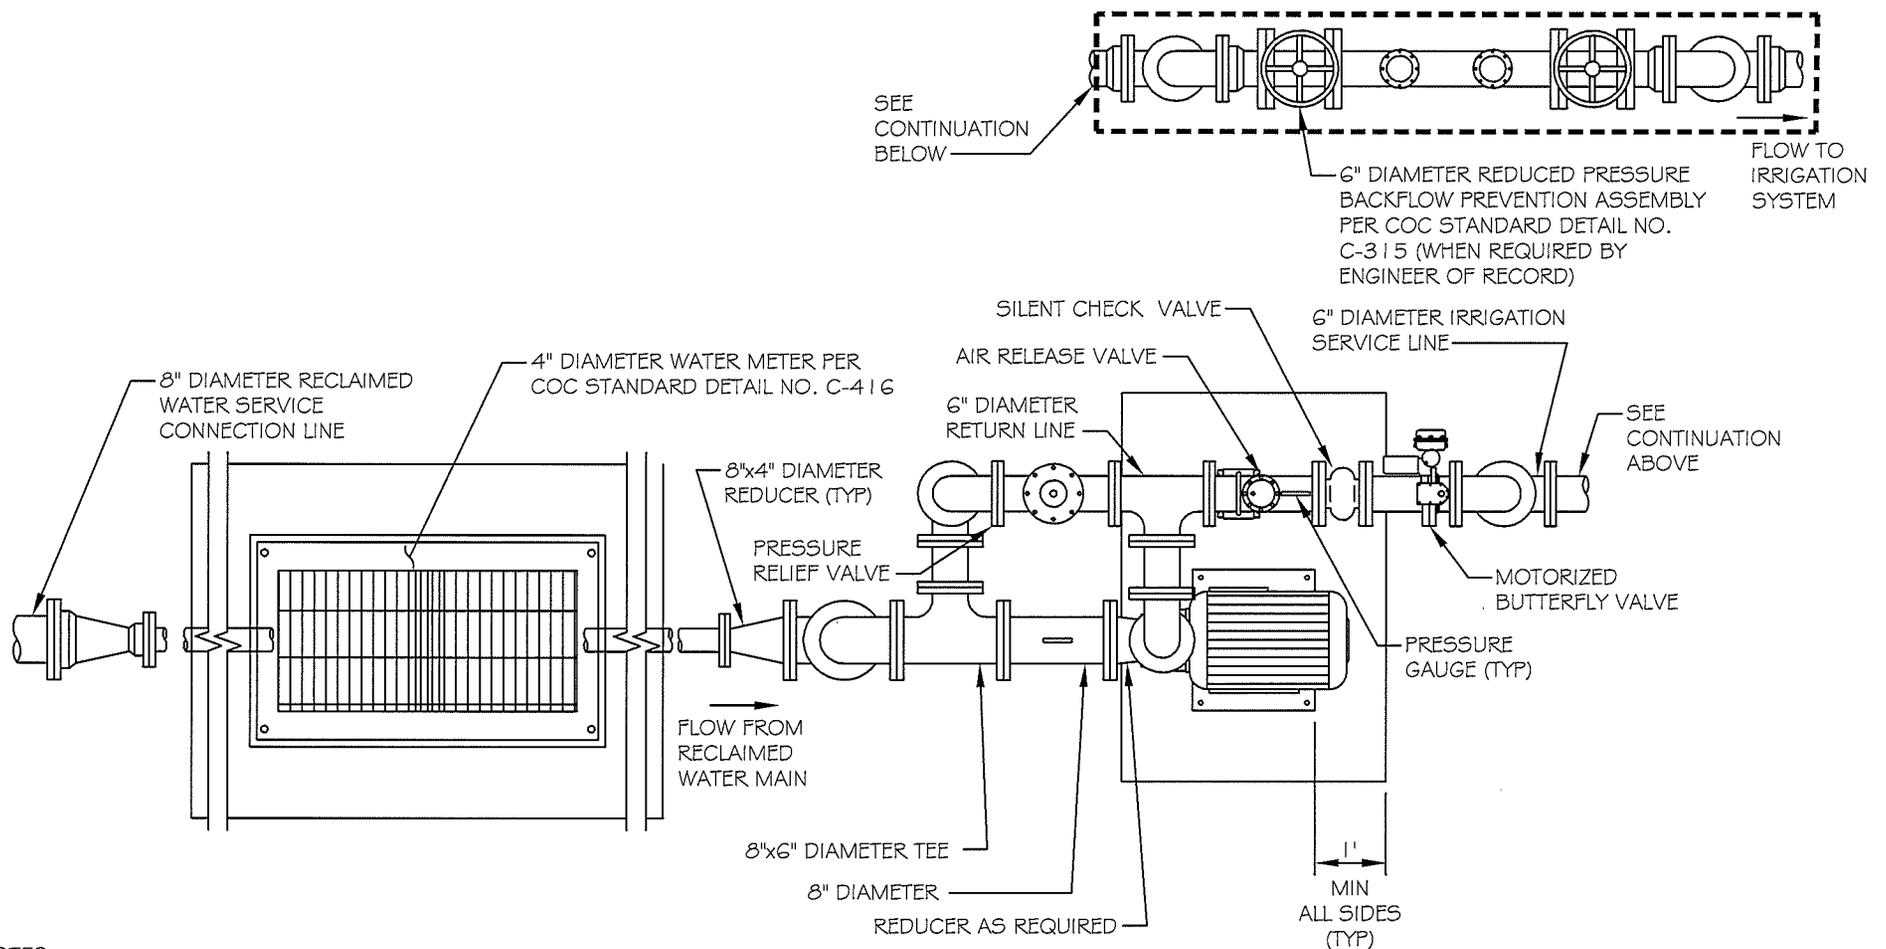

PLAN

NOTES:

1. ALL PIPING SHALL BE DUCTILE IRON (DIP) AS SHOWN.
2. PRESSURE RELIEF VALVE SHALL BE SET AT 2 PSI ABOVE SPRINKLER DESIGN PRESSURE.
3. DEVELOPER SHALL PROVIDE UTILITY SERVICES TO FACILITY AS REQUIRED.
4. DEVELOPER MAY USE VARIABLE FREQUENCY DRIVE WITH PUMP IN LIEU OF RETURN LINE.
5. DEVELOPER SHALL INTERLOCK MOTORIZED BUTTERFLY VALVE TO OPEN/CLOSE ON PUMP START/STOP.

① PRESSURE RELIEF VALVE: CLA VAL MODEL 50-01 OR APPROVED EQUAL

⑧ AIR RELEASE VALVE: APCO MODEL 50 WITH 1" THREADED INLET OR APPROVED EQUAL

② SILENT CHECK VALVE: APCO SERIES 600 OR APPROVED EQUAL

③ MOTORIZED BUTTERFLY VALVE: MUELLER LINE SEAL III OR APPROVED EQUAL

④ SPLIT CASE CENTRIFUGAL PUMP


⑤ PUMP CONCRETE SUPPORT PAD

⑥ 1/2" THREADED OUTLET, BALL VALVE, SS DIAPHRAGM, AND ASHCROFT TYPE 1009 PRESSURE GAUGE (0-150 PSI) OR APPROVED EQUAL

⑦ PIPE SUPPORT: B-LINE FIGURE B3088T, B3089, AND B3090 OR APPROVED EQUAL

6" DIAMETER REDUCED PRESSURE BACKFLOW PREVENTION ASSEMBLY PER COC STANDARD DETAIL NO. C-315 (WHEN REQUIRED BY ENGINEER OF RECORD)

OPTIONAL 1'-0" STRAIGHT RUN WITH PIPE SUPPORT

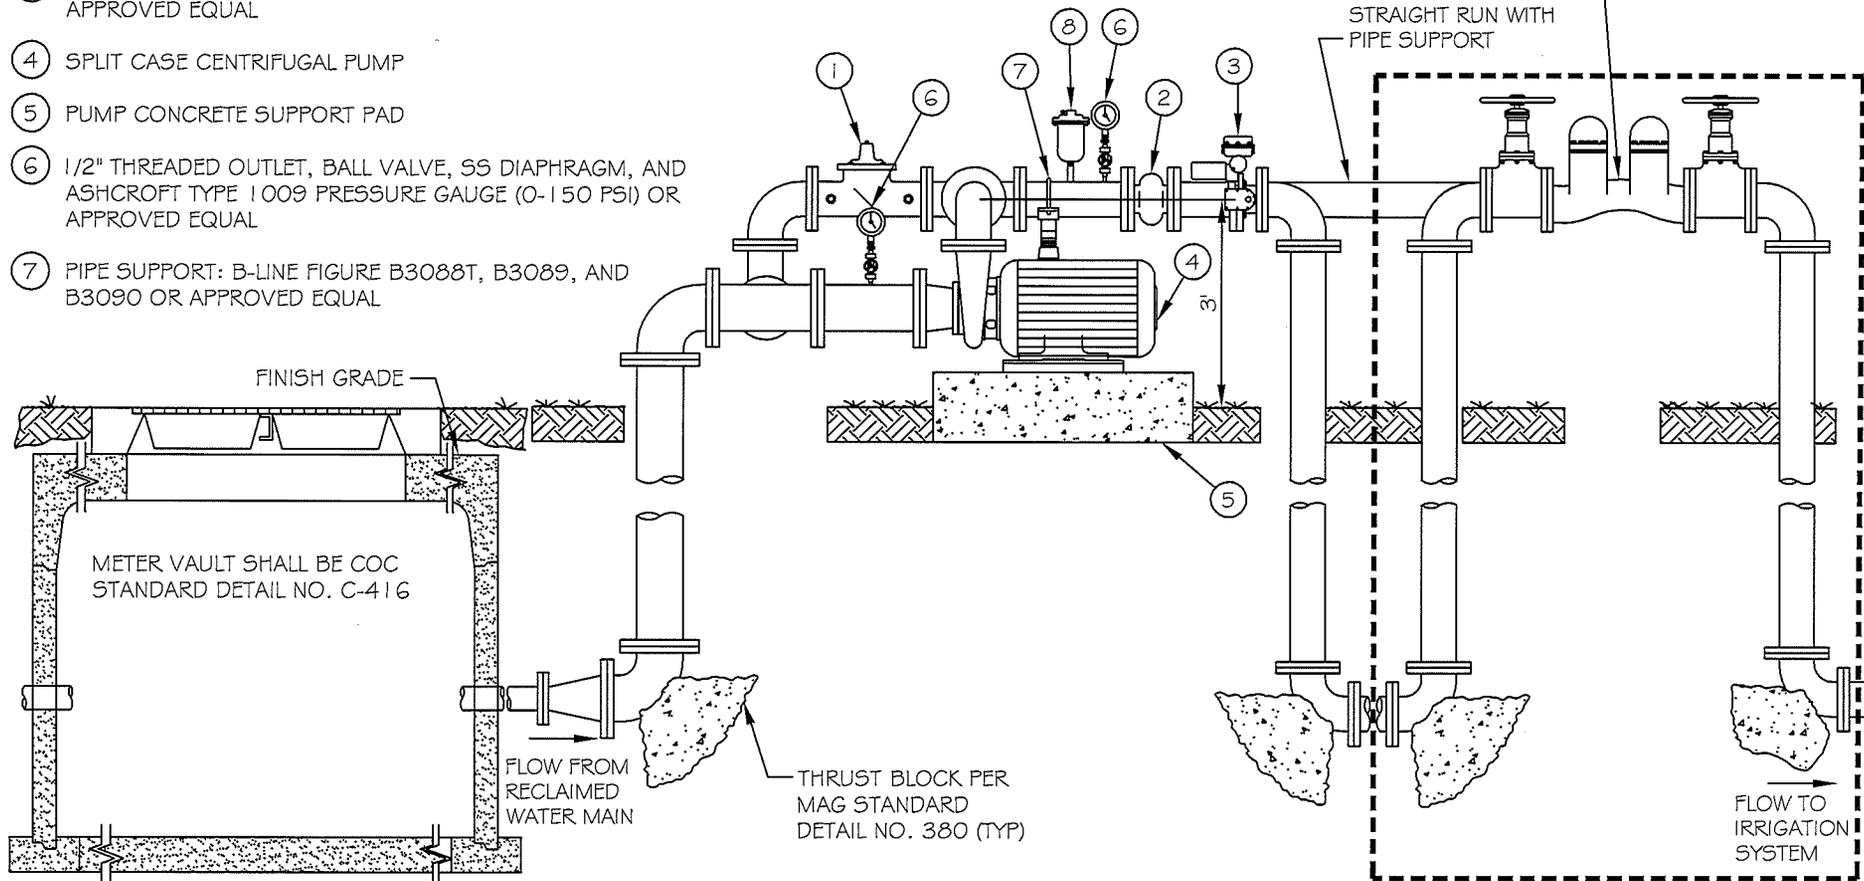

SECTION

DETAIL NO.

C-404

PAGE 8 OF 12



CITY OF
CHANDLER
STANDARD
DETAIL

**6" RECLAIMED WATER
IRRIGATION SERVICE LINE
INLINE PUMP TYPE**

APPROVED:

David W. Webb
CITY ENGINEER

DATE:

1-9-14

DETAIL NO.


C-404

PAGE 8 OF 12

NOTES:

- ① PRESSURE RELIEF VALVE : CLA VAL MODEL 6506-01 B OR APPROVED EQUAL
- ② THRUST BLOCK PER MAG STANDARD DETAIL NO. 380 (TYP)
- ③ PROPERTY SHALL BE FENCED WITH 6 FOOT BLOCK WALL TO MATCH THE SURROUNDING WALL THEME
- ④ PROVIDE 6"x3" REDUCER FOR CONTINUATION OF INSTALLATION OF 6" DIAMETER WATER SERVICE CONNECTION LINE, REDUCER SHALL BE LOCATED 2'-0" MAX FROM METER VAULT
- ⑤ AIR RELEASE VALVE: APCO MODEL 50 WITH 1/2" THREADED INLET OR APPROVED EQUAL

- 1. PRESSURE RELIEF VALVE SHALL BE SET AT 2 PSI ABOVE SPRINKLER DESIGN PRESSURE.
- 2. DEVELOPER SHALL PROVIDE UTILITY SERVICES TO THE FACILITY AS REQUIRED.
- 3. DEVELOPER MAY USE VARIABLE FREQUENCY DRIVE WITH PUMP IN LIEU OF RETURN LINE.
- 4. DEVELOPER SHALL INTERLOCK MOTORIZED BUTTERFLY VALVE TO OPEN/CLOSE ON PUMP START/STOP.

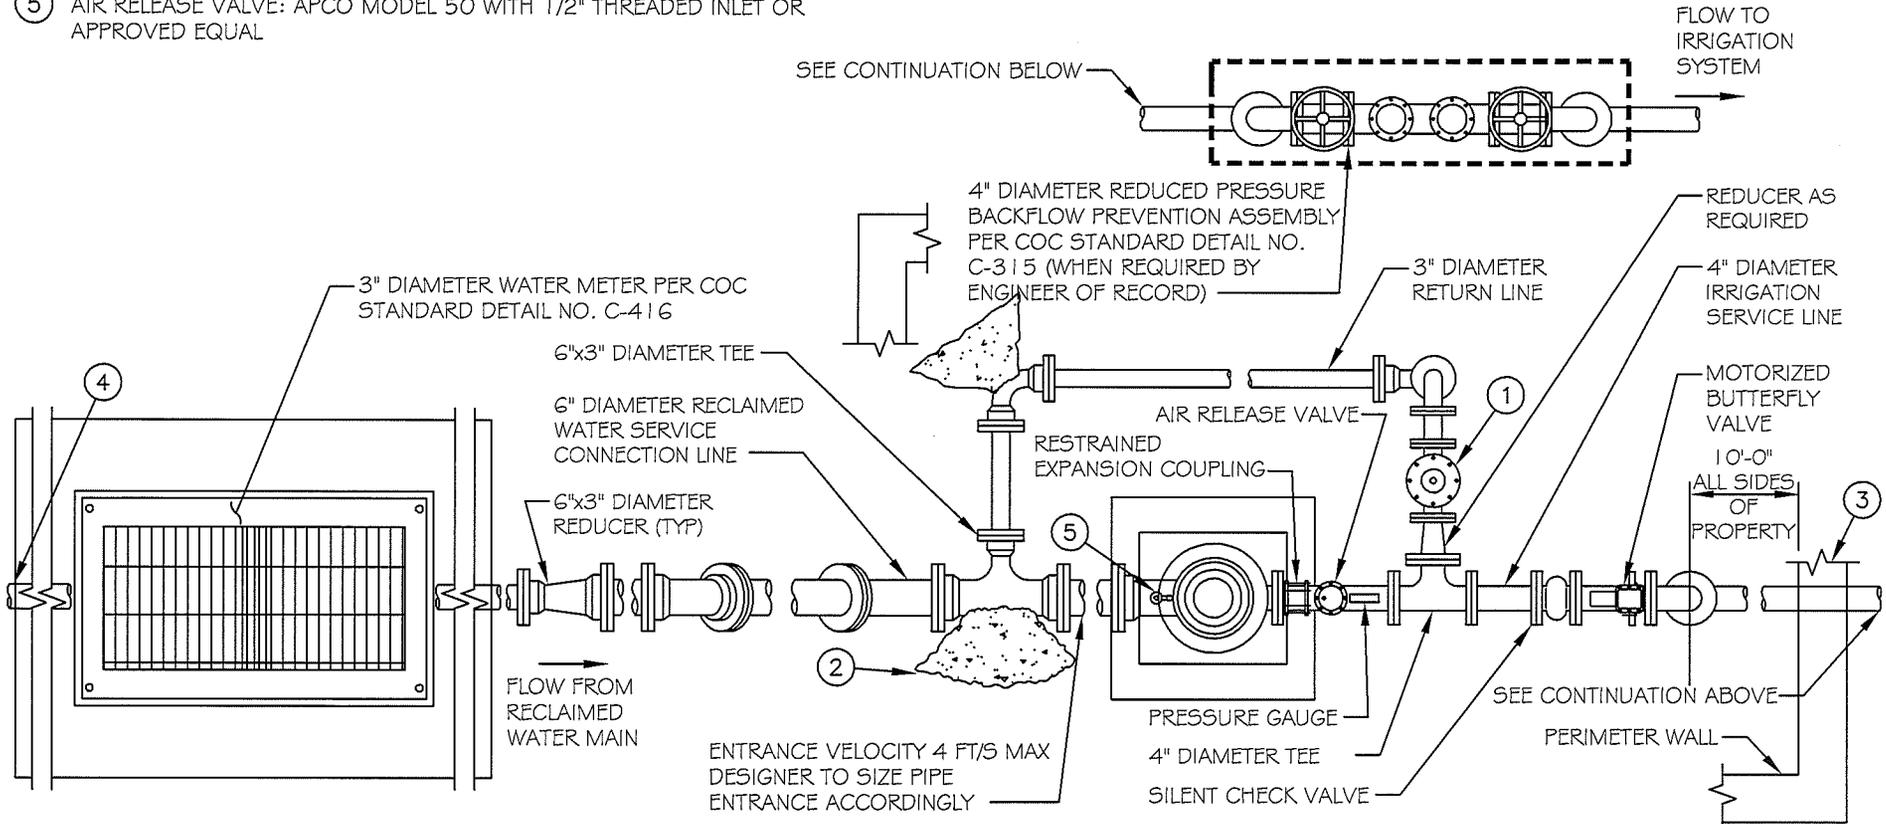

PLAN



**4" RECLAIMED WATER
IRRIGATION SERVICE LINE
CAN PUMP TYPE**


APPROVED: *Daniel W. Berk*
CITY ENGINEER
DATE: 1-9-14

- ① EPOXY LINED STEEL PUMP CAN, THICKNESS PER PUMP MANUFACTURER
- ② 6" CEMENT GROUT SEAL AROUND ENTIRE CAN
- ③ 4" WIDE BY 1/2" THICK STEEL THRUST COLLAR FULL WELD TO PUMP CAN
- ④ PUMP SUPPORT BLOCK
- ⑤ VERTICAL TURBINE PUMP
- ⑥ SILENT CHECK VALVE: APCO SERIES 600 OR APPROVED EQUAL
- ⑦ MOTORIZED BUTTERFLY VALVE: MUELLER LINE SEAL III OR APPROVED EQUAL

- ⑧ RESTRAINED EXPANSION COUPLING: DRESSER STYLE 127 OR APPROVED EQUAL
- ⑨ 1/2" THREADED OUTLET, BALL VALVE, SS DIAPHRAGM, AND ASHCROFT TYPE 1009 PRESSURE GAUGE (0-150 PSI) OR APPROVED EQUAL
- ⑩ PROPERTY SHALL BE FENCED WITH 6 FOOT BLOCK WALL TO MATCH THE SURROUNDING WALL THEME
- ⑪ DIELECTRIC COUPLING
- ⑫ GROUT AROUND ENTIRE MECHANICAL JOINT
- ⑬ AIR RELEASE VALVE: APCO MODEL 50 WITH 1" THREADED INLET OR APPROVED EQUAL

NOTE:

1. ALL PIPING SHALL BE DUCTILE IRON (DIP) AS SHOWN.

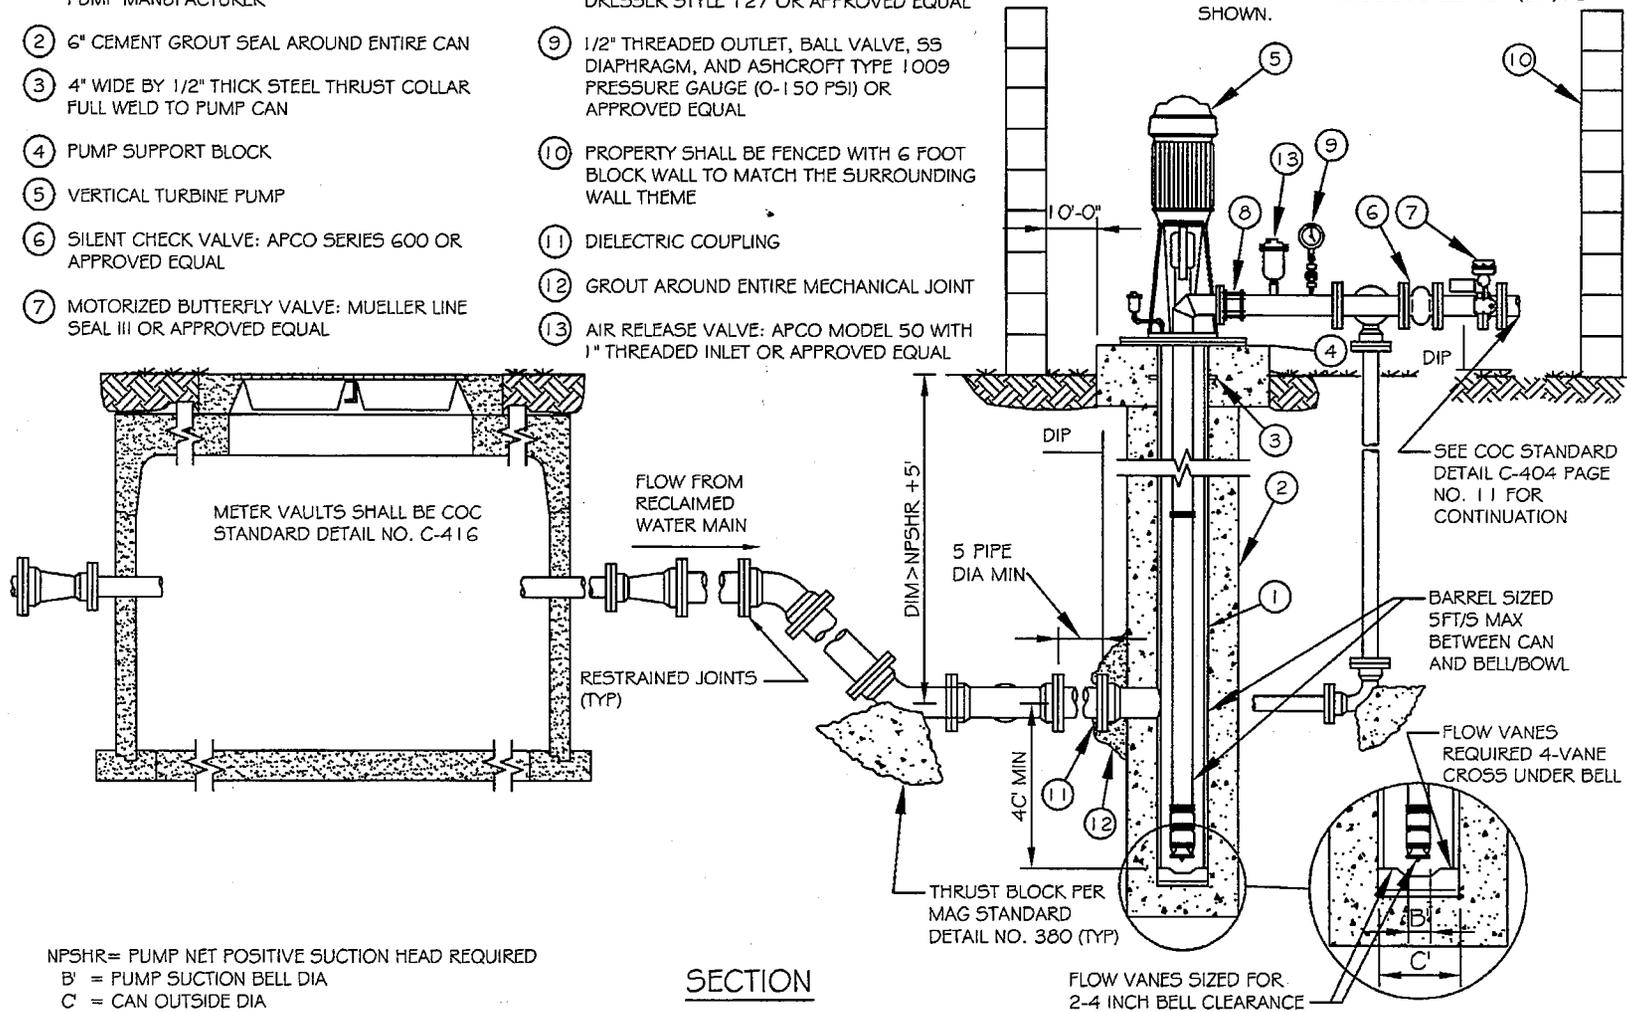

NPSHR = PUMP NET POSITIVE SUCTION HEAD REQUIRED
 B' = PUMP SUCTION BELL DIA
 C = CAN OUTSIDE DIA

SECTION

FLOW VANES SIZED FOR 2-4 INCH BELL CLEARANCE

SEE COC STANDARD DETAIL C-404 PAGE NO. 11 FOR CONTINUATION

BARREL SIZED 5FT/5 MAX BETWEEN CAN AND BELL/BOWL

FLOW VANES REQUIRED 4-VANE CROSS UNDER BELL

DIM > NPSHR + 5'

5 PIPE DIA MIN

4C MIN

THRUST BLOCK PER MAG STANDARD DETAIL NO. 380 (TYP)

DETAIL NO.
C-404
 PAGE 10 OF 12



CITY OF CHANDLER
 STANDARD
 DETAIL

**4" RECLAIMED WATER
 IRRIGATION SERVICE LINE
 CAN PUMP TYPE**


APPROVED: *[Signature]*
 CITY ENGINEER
 DATE: June 12/08

DETAIL NO.
C-404
 PAGE 10 OF 12


NOTES:

- ① PRESSURE RELIEF VALVE - CLA VAL MODEL 650G-01B OR APPROVED EQUAL
- ② THRUST BLOCK PER MAG STANDARD DETAIL NO. 380 (TYP)
- ③ PROPERTY SHALL BE FENCED WITH 6 FOOT BLOCK WALL TO MATCH THE SURROUNDING WALL THEME
- ④ PROVIDE 8"x4" REDUCER FOR CONTINUATION OF INSTALLATION OF 8" DIAMETER WATER SERVICE CONNECTION LINE, REDUCER SHALL BE LOCATED 2' MAX FROM METER VAULT
- ⑤ AIR RELEASE VALVE: APCO MODEL 50 WITH 1/2" THREADED INLET OR APPROVED EQUAL

- 1. PRESSURE RELIEF VALVE SHALL BE SET AT 2 PSI ABOVE SPRINKLER DESIGN PRESSURE.
- 2. DEVELOPER SHALL PROVIDE UTILITY SERVICES TO THE FACILITY AS REQUIRED.
- 3. DEVELOPER MAY USE VARIABLE FREQUENCY DRIVE WITH PUMP IN LIEU OF RETURN LINE.
- 4. DEVELOPER SHALL INTERLOCK MOTORIZED BUTTERFLY VALVE TO OPEN/CLOSE ON PUMP START/STOP.

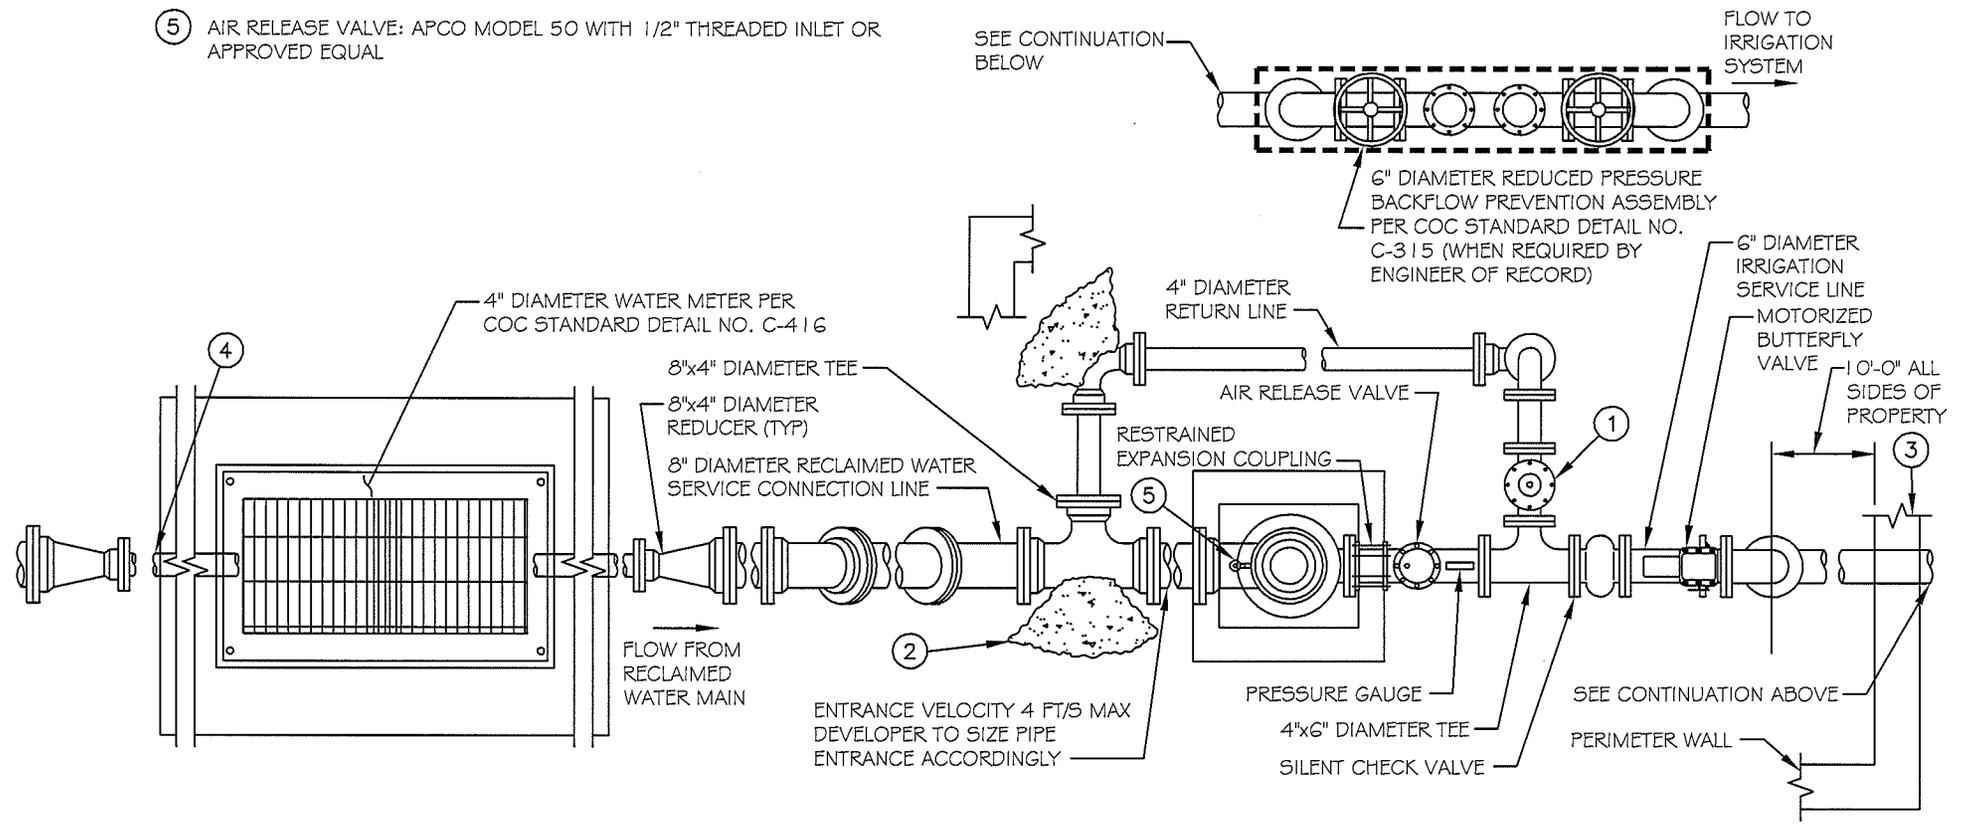

DETAIL NO.
C-404
PAGE II OF 12

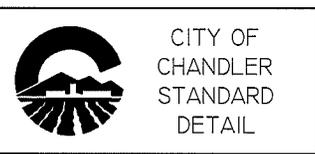

**6" RECLAIMED WATER
IRRIGATION SERVICE LINE
CAN PUMP TYPE**

APPROVED: *Daniel Wells*
CITY ENGINEER
DATE: 1-9-14


DETAIL NO.
C-404
PAGE II OF 12

- ① EPOXY LINED STEEL PUMP CAN, THICKNESS PER PUMP MANUFACTURER
- ② 6" CEMENT GROUT SEAL AROUND ENTIRE CAN
- ③ 4" WIDE BY 1/2" THICK STEEL THRUST COLLAR FULL WELD TO PUMP CAN
- ④ PUMP SUPPORT BLOCK
- ⑤ VERTICAL TURBINE PUMP
- ⑥ SILENT CHECK VALVE: APCO SERIES 600 OR APPROVED EQUAL
- ⑦ MOTORIZED BUTTERFLY VALVE: MUELLER LINE SEAL III OR APPROVED EQUAL

- ⑧ RESTRAINED EXPANSION COUPLING: DRESSER STYLE 127 OR APPROVED EQUAL
- ⑨ 1/2" THREADED OUTLET, BALL VALVE, SS DIAPHRAGM, AND ASHCROFT TYPE 1009 PRESSURE GAUGE (0-150 PSI) OR APPROVED EQUAL
- ⑩ PROPERTY SHALL BE FENCED WITH 6 FOOT BLOCK WALL TO MATCH THE SURROUNDING WALL THEME
- ⑪ DIELECTRIC COUPLING
- ⑫ GROUT AROUND ENTIRE MECHANICAL JOINT
- ⑬ AIR RELEASE VALVE: APCO MODEL 150 WITH 1" THREADED INLET OR APPROVED EQUAL

NOTE:

1. ALL PIPING SHALL BE DUCTILE IRON (DIP) AS SHOWN

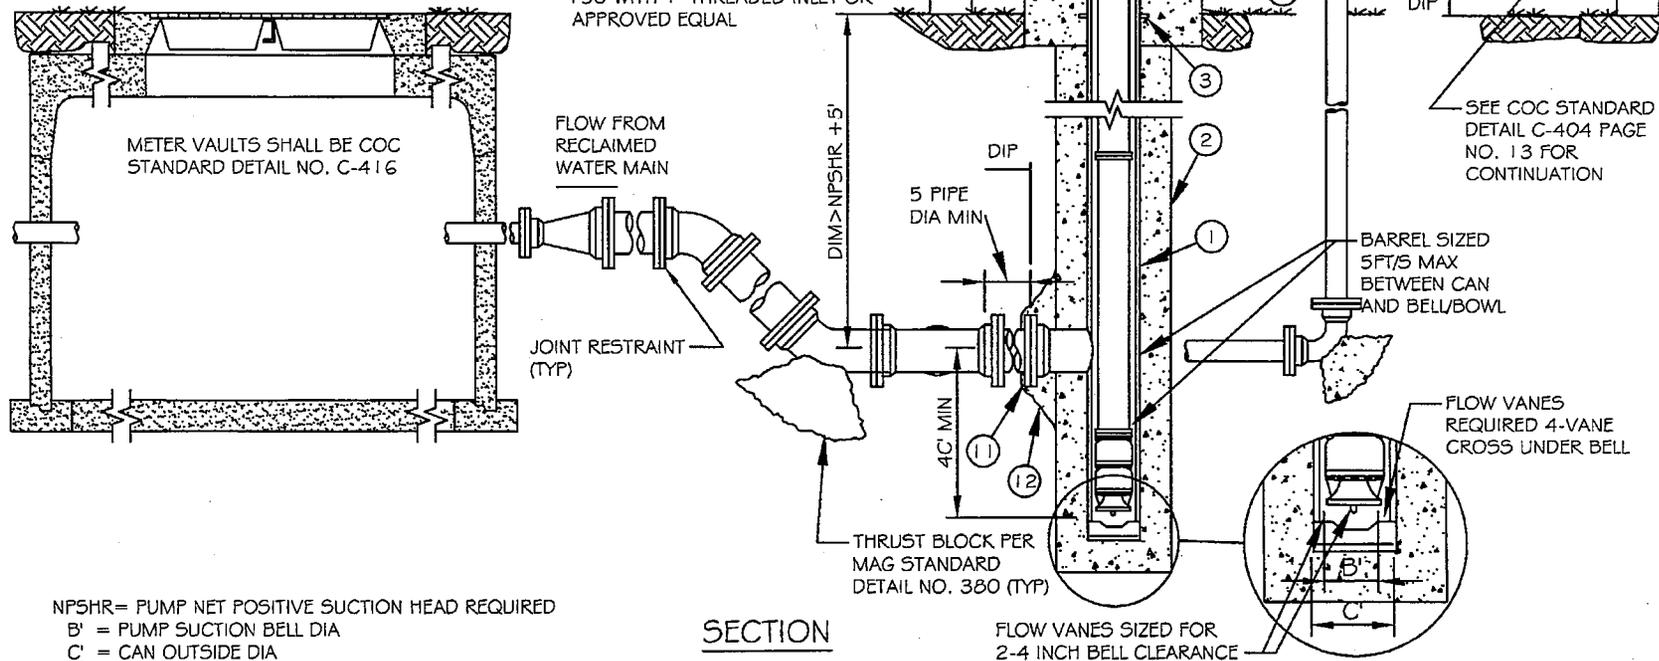

DETAIL NO.
C-404
PAGE 12 OF 12



CITY OF
CHANDLER
STANDARD
DETAIL

**6" RECLAIMED WATER
IRRIGATION SERVICE LINE
CAN PUMP TYPE**

APPROVED:

Blair Hill
CITY ENGINEER


DATE:

June 12/08

DETAIL NO.

C-404

PAGE 12 OF 12

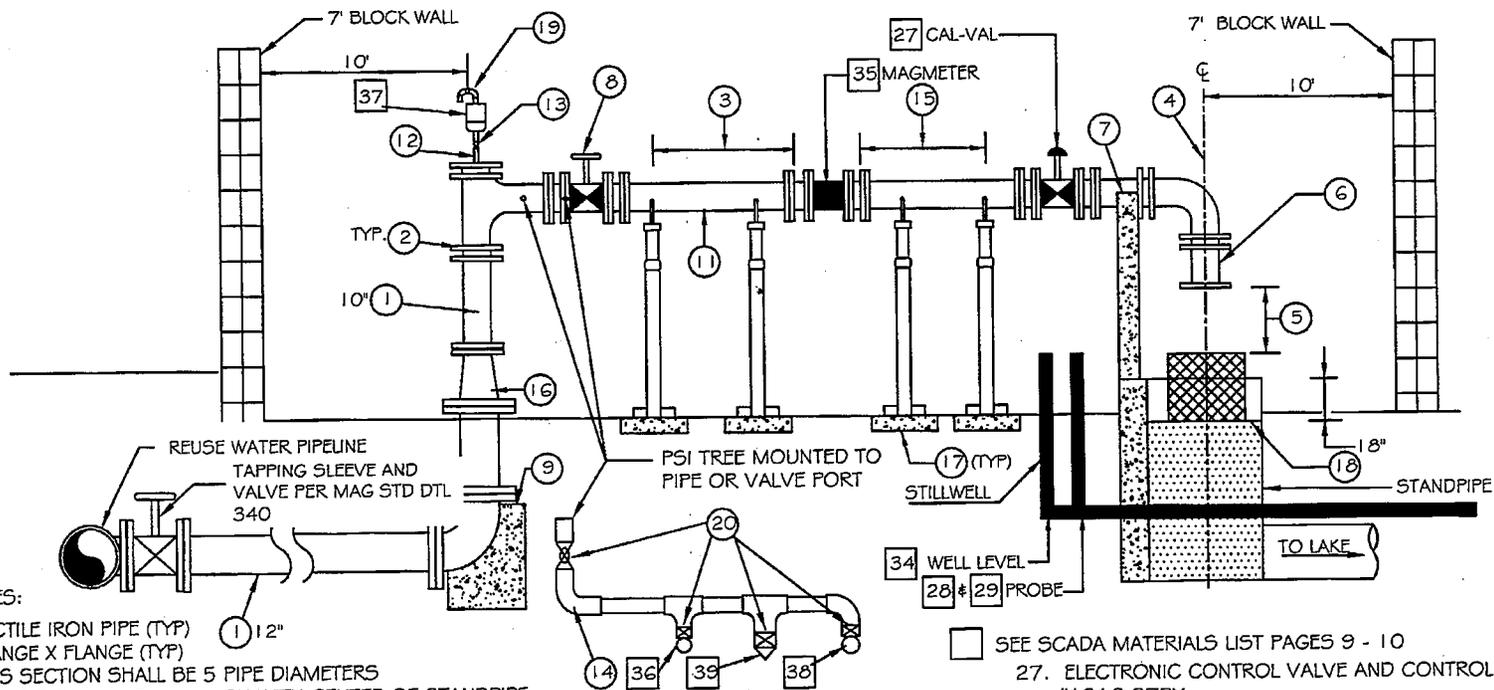

NOTES:

1. DUCTILE IRON PIPE (TYP) 12"
2. FLANGE X FLANGE (TYP)
3. THIS SECTION SHALL BE 5 PIPE DIAMETERS
4. PIPE DISCHARGE SHALL ALIGN WITH CENTER OF STANDPIPE
5. THIS SPACING SHALL BE GREATER THAN 2 PIPE DIAMETERS FOR AIR GAP
6. 1' SPOOL PIECE
7. PROVIDE CONCRETE SUPPORTS AS SHOWN
8. PROVIDE RESILIENT SEAT GATE VALVE
9. PROVIDE THRUST BLOCK PER MAG STD DTL 380
10. (NOT USED)
11. 10" D.I.P., TYP.
12. ALL 2" & 1" PIPE SHOULD BE BRASS
13. 2" BALL-CORP VALVE BRASS MALE IN/OUT
14. 1" PSI TREE-SEE DETAIL-BRASS
15. THIS SECTION SHALL BE 3 PIPE DIAMETERS
16. REDUCER MAY BE INSTALLED 12" X 10"
17. PIPE SUPPORTS BOLTED TO 6" CONCRETE FOOTING (TYP)
18. METAL GRATE BOX OVER TOP OF STANDPIPE
19. ALL BRASS FITTINGS
20. 1" BALL-CORP VALVE BRASS



NOTES:

1. PROPERTY SHALL BE DEDICATED TO CITY AND KEYED TO CITY LOCK SYSTEM.
2. PROPERTY SHALL BE FENCED WITH 7' BLOCK WALL TO MATCH THE SURROUNDING WALL THEME.
3. THE TURNOUT STRUCTURE SHALL HAVE THE CAPACITY TO CONVEY 2,000 GPM WITHOUT OVERFLOWING.
4. WIRING TRENCH AND JUNCTION BOXES SHALL BE LOCATED ON FAR SIDE OF PIPE AWAY FROM GATE.

SEE SCADA MATERIALS LIST PAGES 9 - 10

27. ELECTRONIC CONTROL VALVE AND CONTROLLER CLA-VAL #131G-37BY
28. LEVEL PROBE WIRE #3W1
29. PROBE FITTING 3E-3B
34. WELL LEVEL TRANSDUCER CWLTY
35. MAG METER CADILLAC #CMAGxRCF15055FM
36. GAUGE #AX9831741-4
37. AIR RELIEF/VACUUM CHECK 2" #144DAT.1-F2-1G/57
38. PRESSURE TRANSMITTER #CPLVY-0303-2013-Z-RNG
39. CALIBRATION PORT: BRASS


DETAIL NO. C-405 NTS	 CITY OF CHANDLER STANDARD DETAIL	LARGE WATER USER (WITH LAKE) RECLAIMED WATER TURNOUT	APPROVED: <i>[Signature]</i> CITY ENGINEER DATE: 01/08/09	DETAIL NO. C-405 PAGE 1 OF 12
-----------------------------------	--	--	---	--

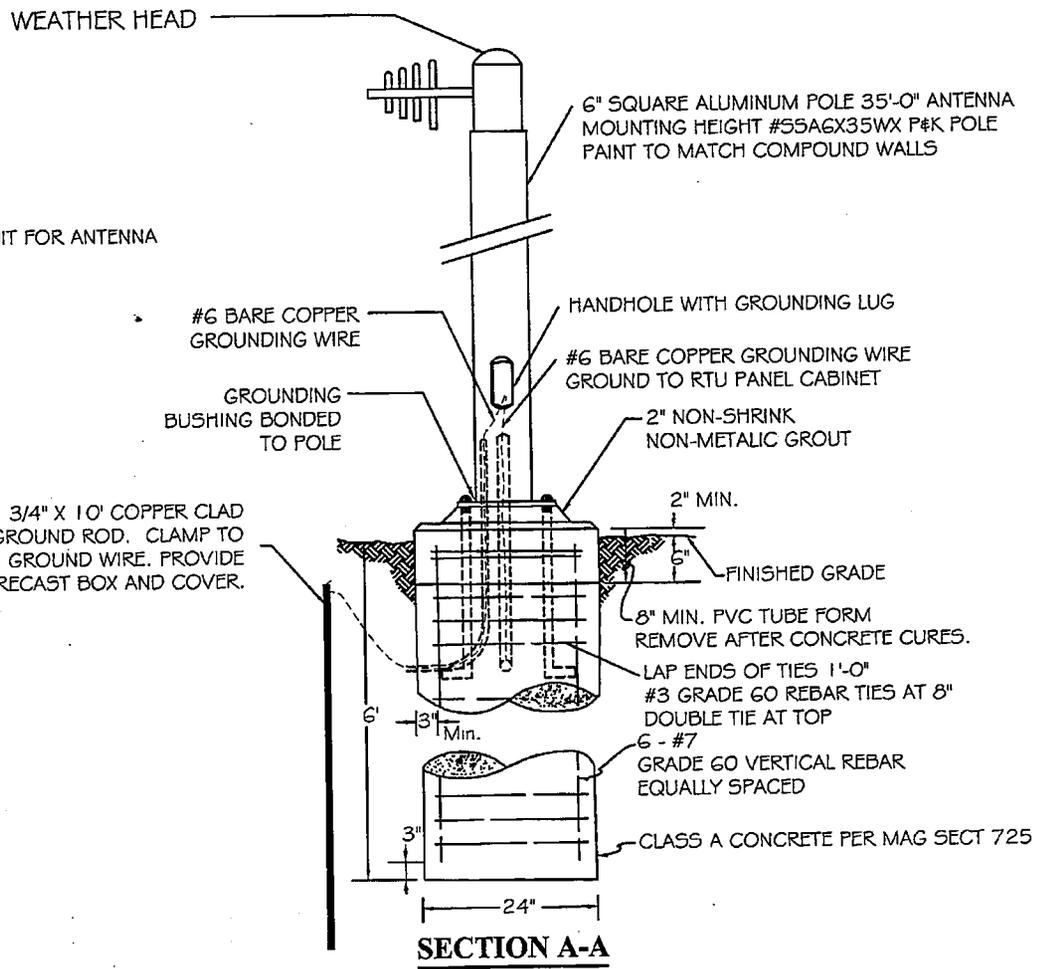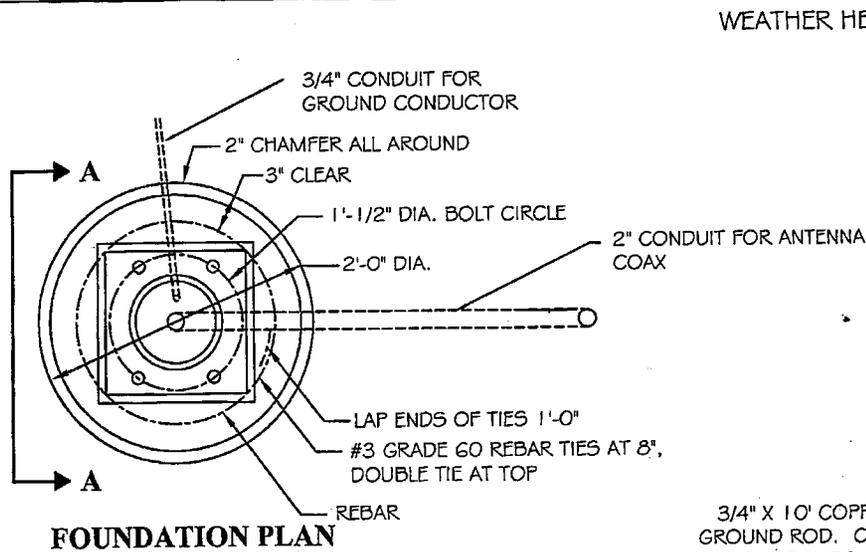


NOTES:

1. THE COMPLETE INSTALLATION SHALL WITHSTAND 110 MHP WINDS.
2. ANCHOR BOLTS, LEVELING NUTS, AND POLE BASE SHALL BE FABRICATED BY POLE MANUFACTURER.

DETAIL NO. C- 405 NTS	 CITY OF CHANDLER STANDARD DETAIL	ANTENNA	APPROVED: <i>[Signature]</i> CITY ENGINEER DATE: <u>01/08/09</u>	DETAIL NO. C- 405 PAGE 2 OF 12
------------------------------------	--	----------------	--	---

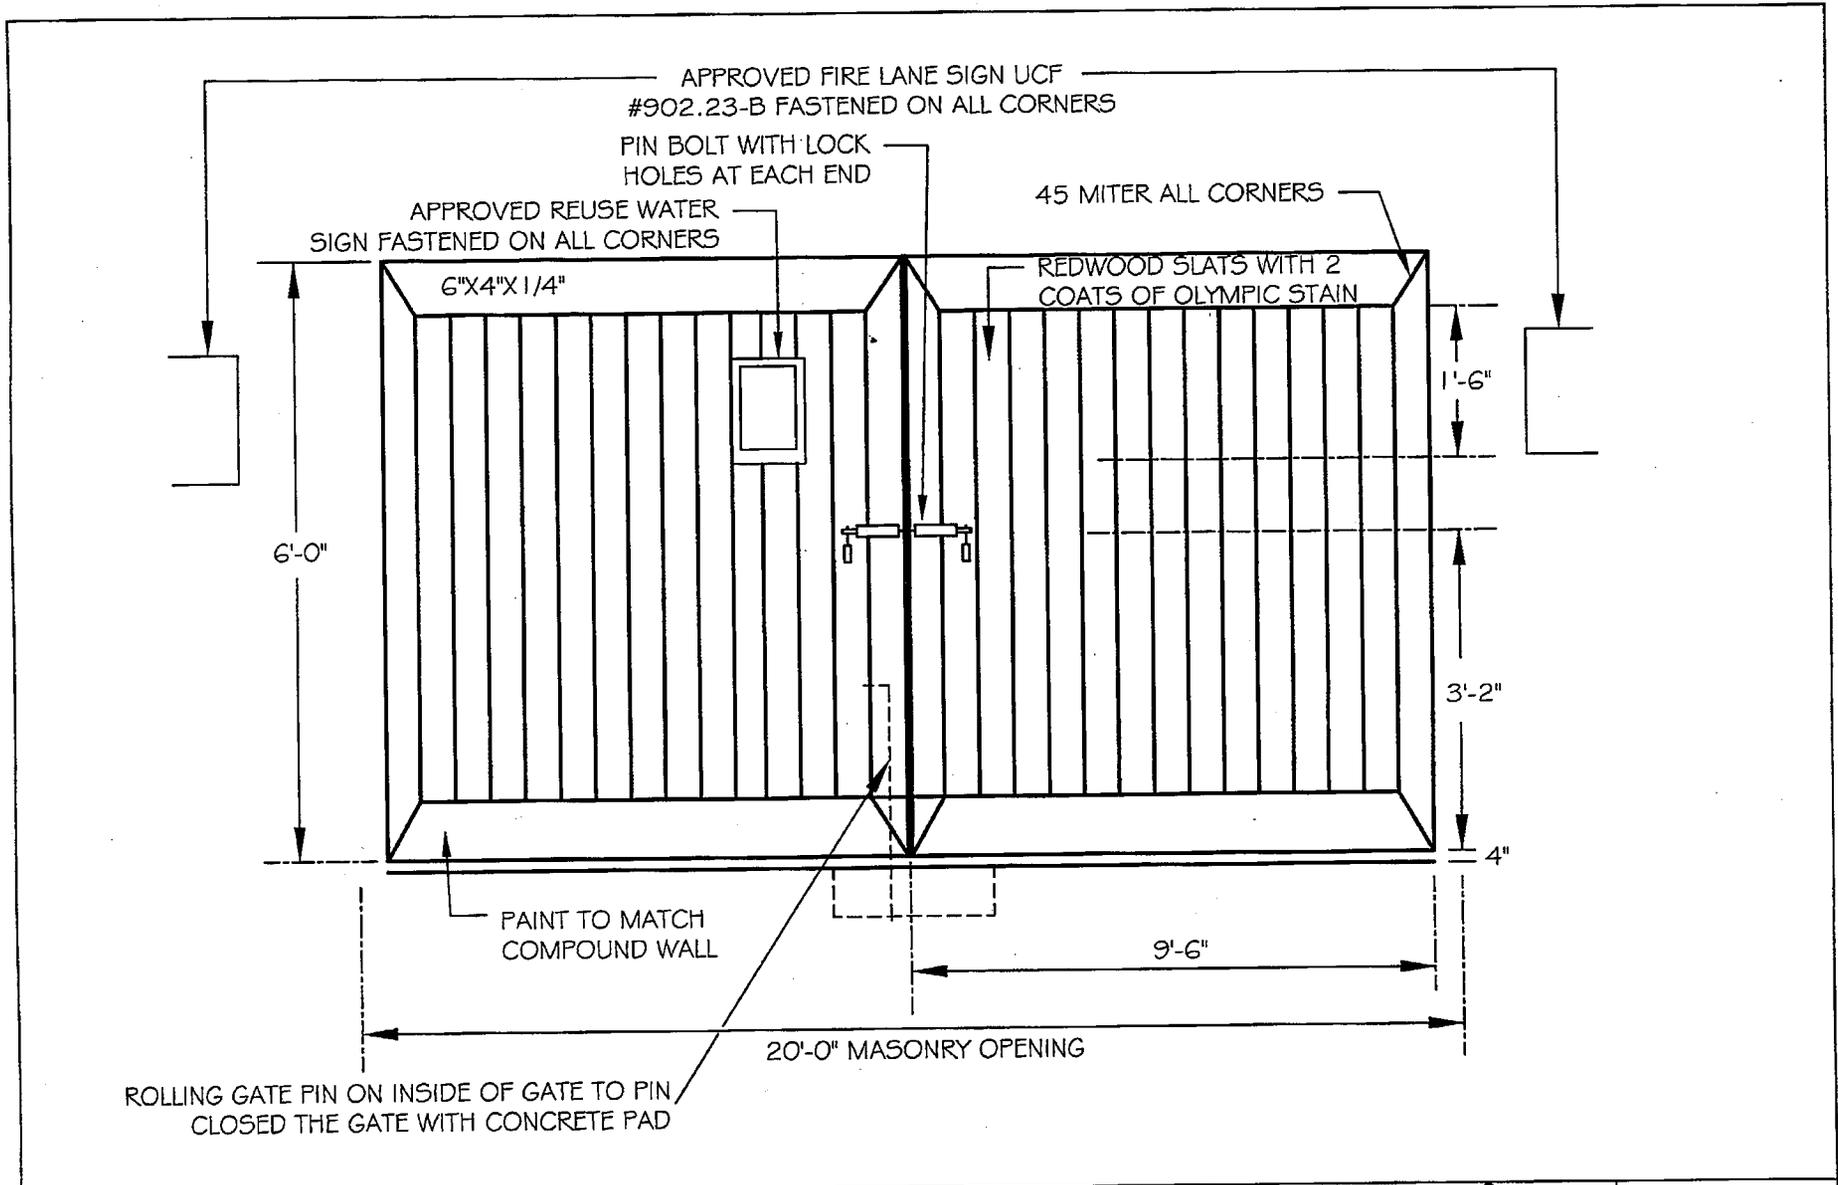



DETAIL NO. C- 405 NTS	 CITY OF CHANDLER STANDARD DETAIL	ROLLING GATE	APPROVED: <i>[Signature]</i> CITY ENGINEER DATE: <u>01/08/09</u>	DETAIL NO. C- 405 PAGE 3 OF 12
------------------------------------	---	---------------------	--	---

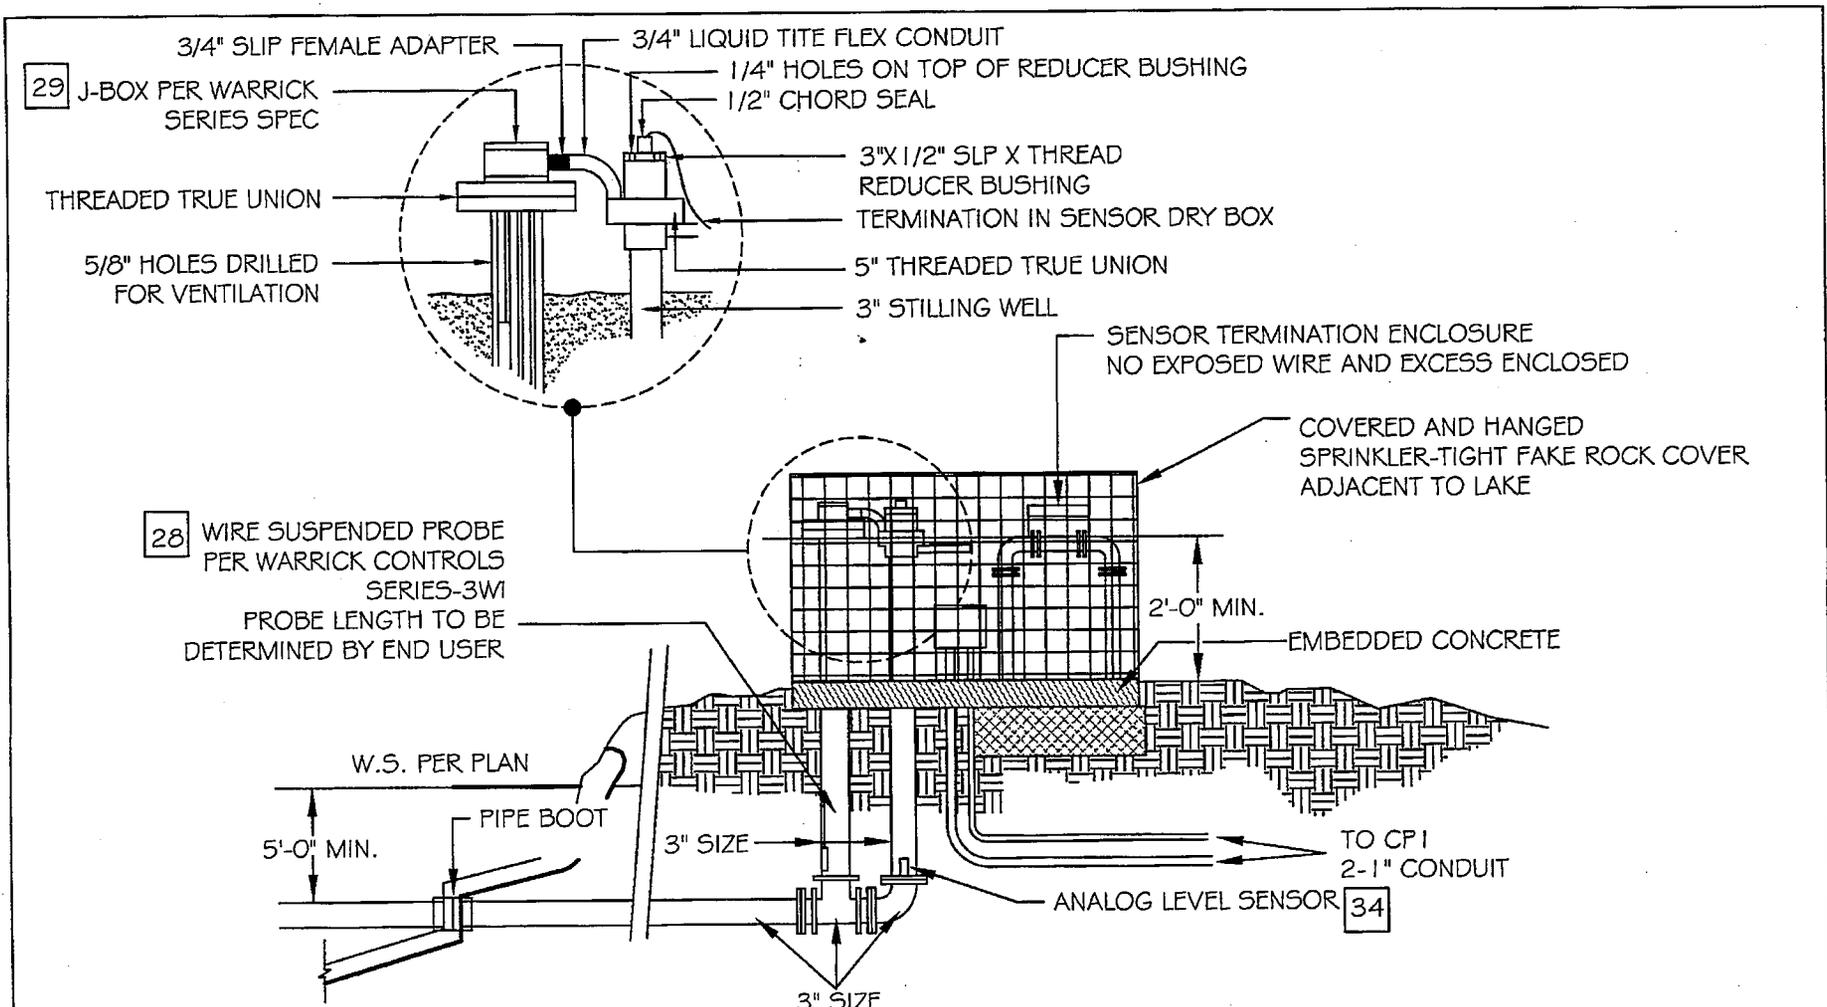


NOTES:

1. LEVEL SENSORS MAY BE LOCATED WITHIN WALLED TURNOUT COMPOUND OR ADJACENT TO LAKE.
2. WHERE ADJACENT TO LAKE, LEVEL SENSORS SHALL BE PROTECTED BY A SCREENED ENCLOSURE COVER BY SIMULATED ROCK.
3. SIMULATED ROCK SHALL BE KRUP.COM INC #AE-CROWN, ORBIT IRRIGATION PRODUCTS INC #35016 GRANITE ROCK BOX, OR ARMORCAST PRODUCTS #P218
4. LEVEL CONTROL LOCATION SHALL BE FIELD LOCATED IN CONSULTATION WITH MR. DAVID CLARK (480) 783-3720

DETAIL NO. C-405 NTS	 CITY OF CHANDLER STANDARD DETAIL	LEVEL SENSORS	APPROVED:  CITY ENGINEER DATE: 01/08/09	DETAIL NO. C-405 PAGE 4 OF 12
-----------------------------------	--	----------------------	--	--

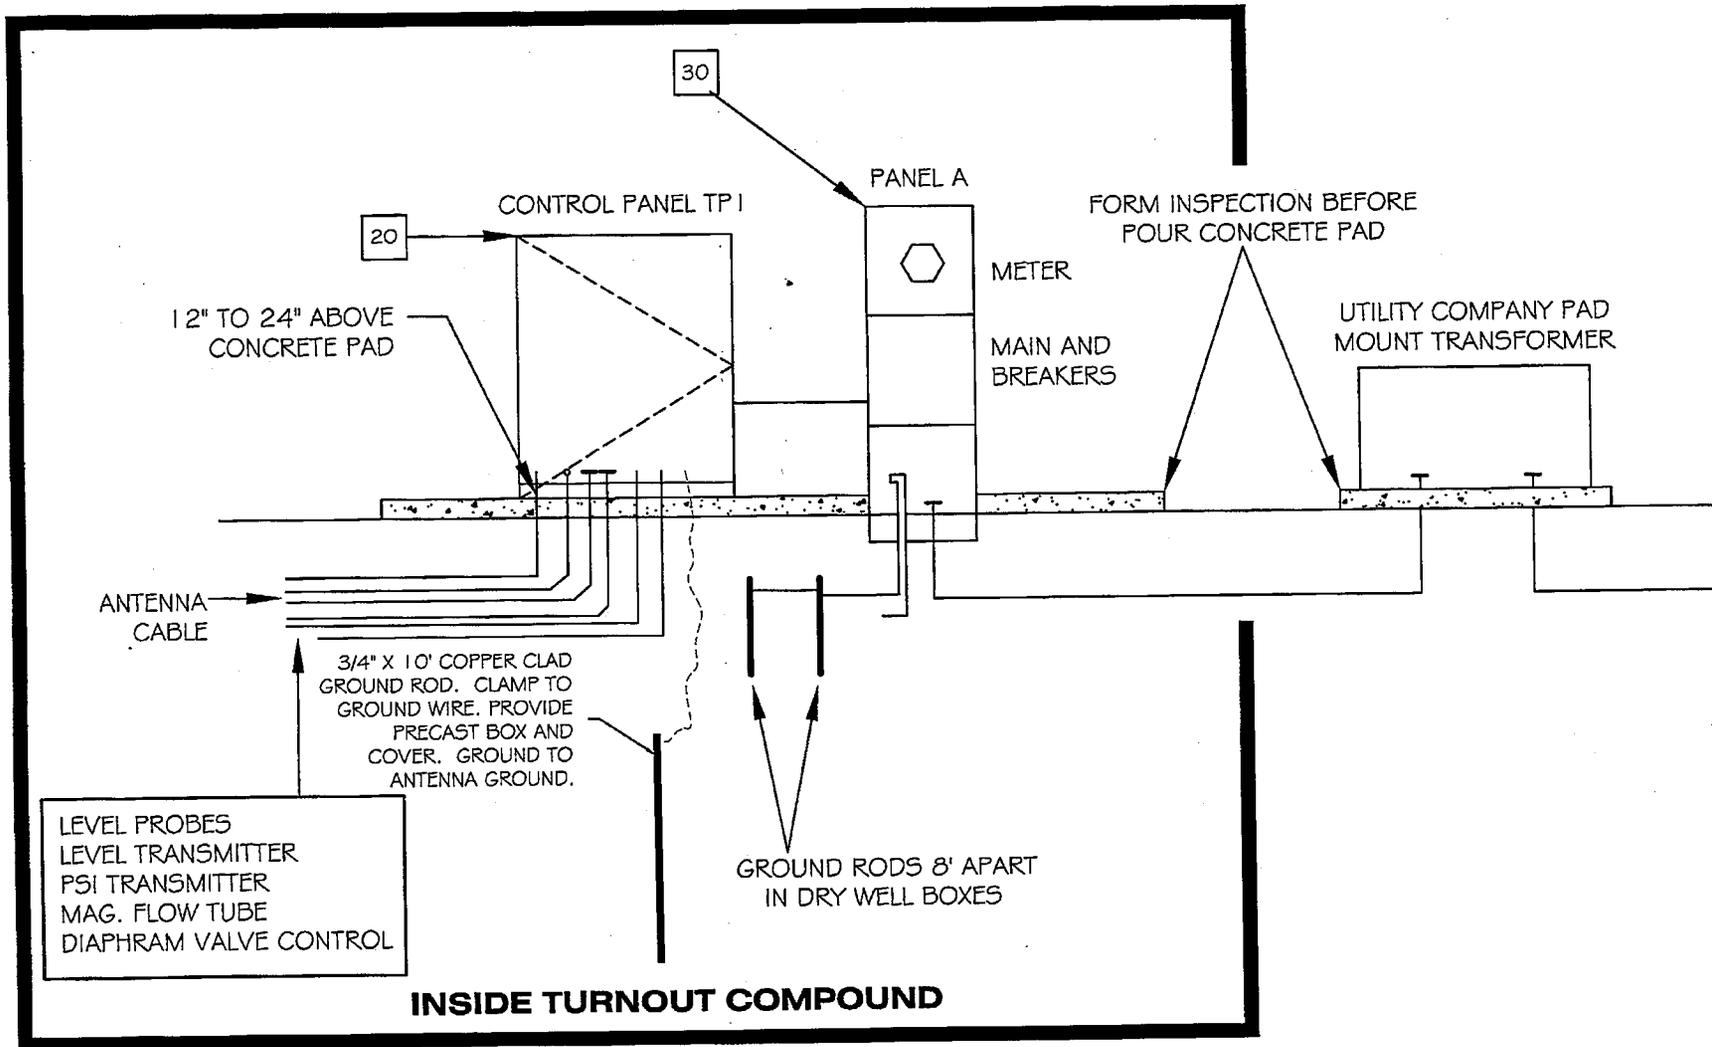

DETAIL NO. C- 405 NTS	 CITY OF CHANDLER STANDARD DETAIL	METERPED	APPROVED: <i>[Signature]</i> CITY ENGINEER DATE: <u>01/08/09</u>	DETAIL NO. C- 405 PAGE 5 OF 12
------------------------------------	---	-----------------	--	---

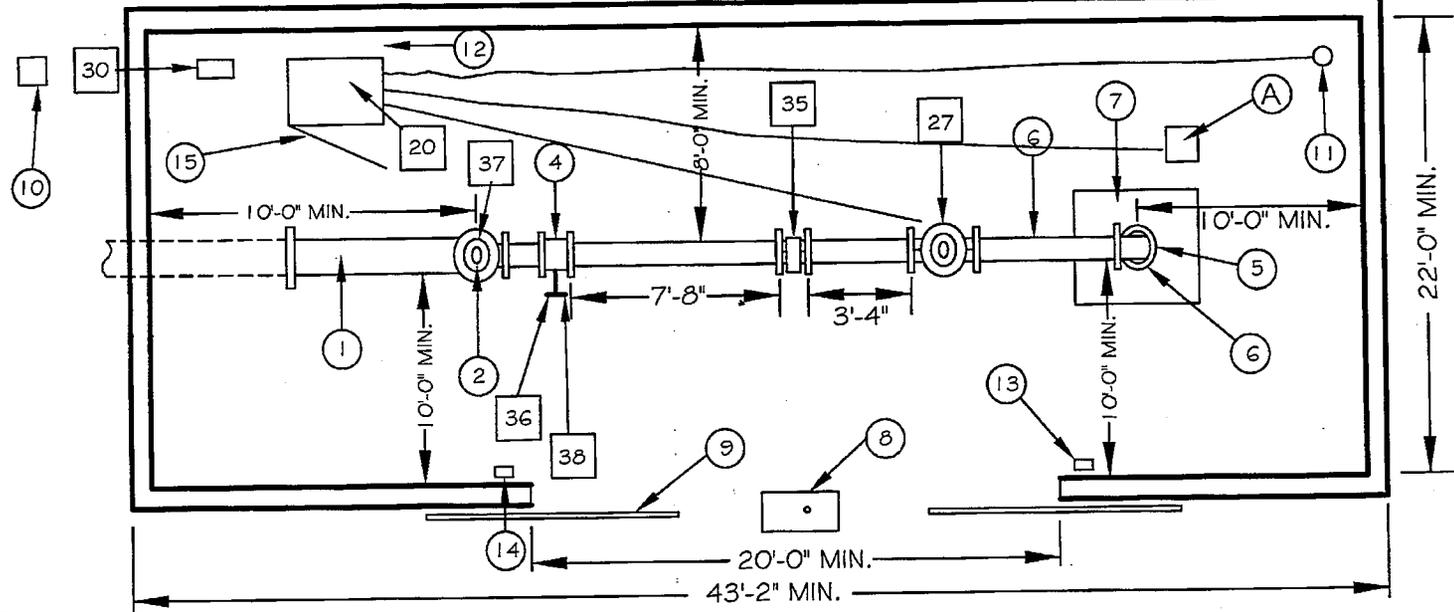

NOTES:

- 1 1 1/2" DUCTILE IRON PIPE
- 2 2" BALL-CORP. STOP-MALE BRASS PIPE IN/OUT
- 3 1 1/2"X1 0" CONCENTRIC REDUCER (NOT SHOWN)
- 4 1 0" VALVE PER "KENNEDY VALVE" KENSEAL II WITH FLANGED ENDS
- 5 1 0" DUCTILE IRON 90 DEGREE ELBOW
- 6 1 0" DUCTILE IRON SPOOL PIECE
- 7 SAFETY SCREEN
- 8 ROLLING GATE PIN PAD
- 9 ROLLING GATE PIN ON INSIDE
- 10 UTILITY COMPANY PAD MOUNT TRANSFORMER
- 11 ANTENNA
- 12 MAINTAIN 2' CLEARANCE
- 13 LIGHT & AC OUTLET
- 14 LIGHT AC OUTLET & SWITCH
- 15 DOOR OPENING AS SHOWN
- A LEVEL SENSORS

BOXED NOTES - SEE SCADA MATERIAL LISTS PAGES 9 & 10

- 20 CONTROL PANEL
- 27 CLA-VAL ELECTRIC VALVE
- 30 SRP METER PAD
- 35 1 0" MAG. METER
- 36 4" PRESSURE GAUGE
- 37 2" AIR RELEASE VALVE/VACUUM CHECK
- 38 PRESSURE TRANSMITTER

ALL CONDUIT RUNS SHALL BE LOCATED ON CONTROL PANEL SIDE OF COMPOUND.

DETAIL NO.
C- 405
NTS



CITY OF
CHANDLER
STANDARD
DETAIL

TURNOUT COMPOUND

APPROVED: *[Signature]*
CITY ENGINEER
DATE: *01/06/09*

DETAIL NO.
C- 405
PAGE 6 OF 12

NOTES

CONSTRUCTION IN ACCORDANCE WITH MAG SECT 510

CONCRETE SHALL BE IN ACCORDANCE WITH MAG SECT 725

REINFORCING STEEL SHALL CONFORM TO ASTM SPEC A615 GRADE 60


CONTROL JOINTS AT 24' INTERVALS

MASONRY: $f_m = 1500$ psi, ASTM C90, MEDIUM OR NORMAL WEIGHT, RUNNING BOND, SLUMP BLOCK.


MORTAR: ASTM C270, TYPE 5

GROUT: ASTM C476, TYPE COARSE

JOINT REINFORCEMENT: 9 GAUGE LADDER OR TRUSS TYPE, STANDARD WEIGHT, $f_y = 33,000$ psi, WIRE PER ASTM A82

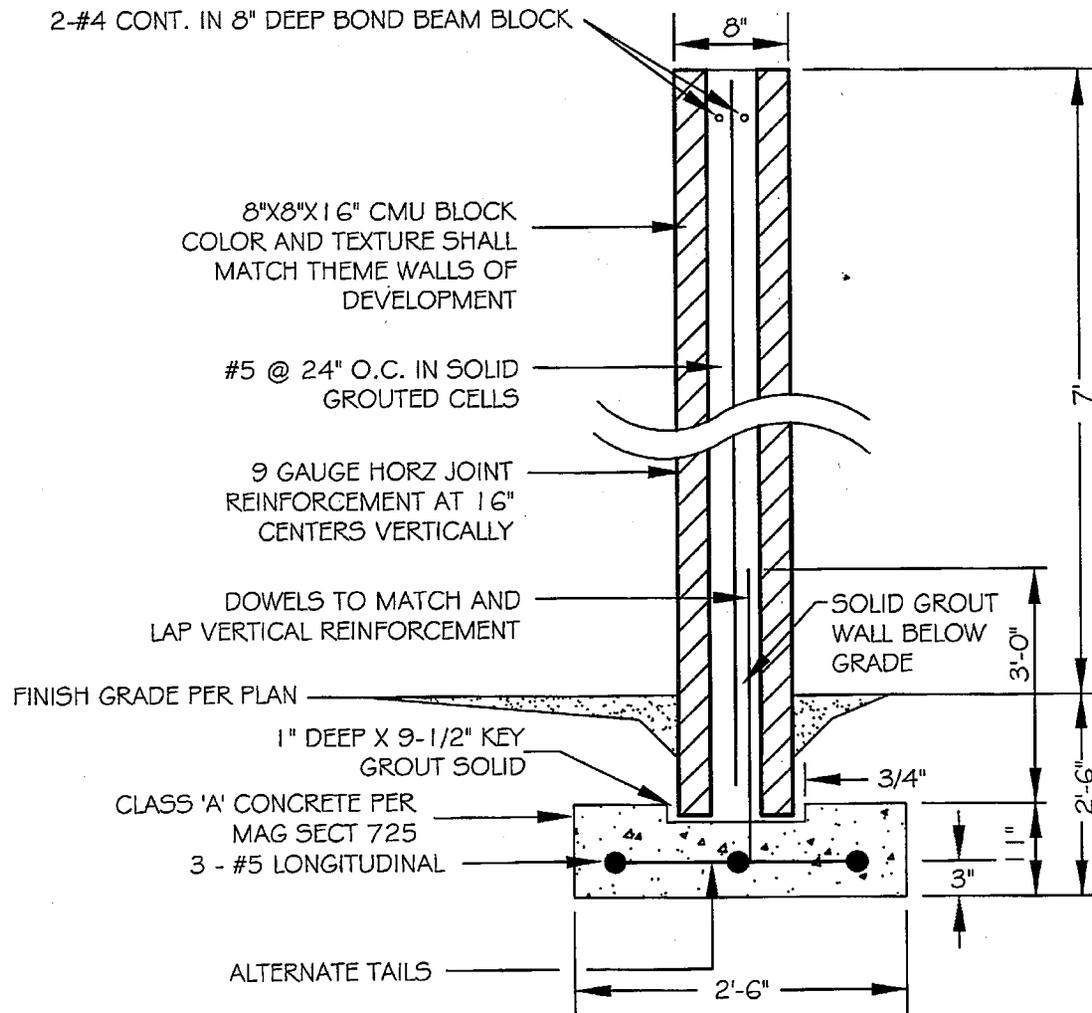

<p>DETAIL NO. C-405 NTS</p>	 <p>CITY OF CHANDLER STANDARD DETAIL</p>	<p>COMPOUND WALL</p>	<p>APPROVED: <i>[Signature]</i> CITY ENGINEER DATE: 01/09/09</p>	<p>DETAIL NO. C-405 PAGE 7 OF 12</p>
--	---	-----------------------------	--	---

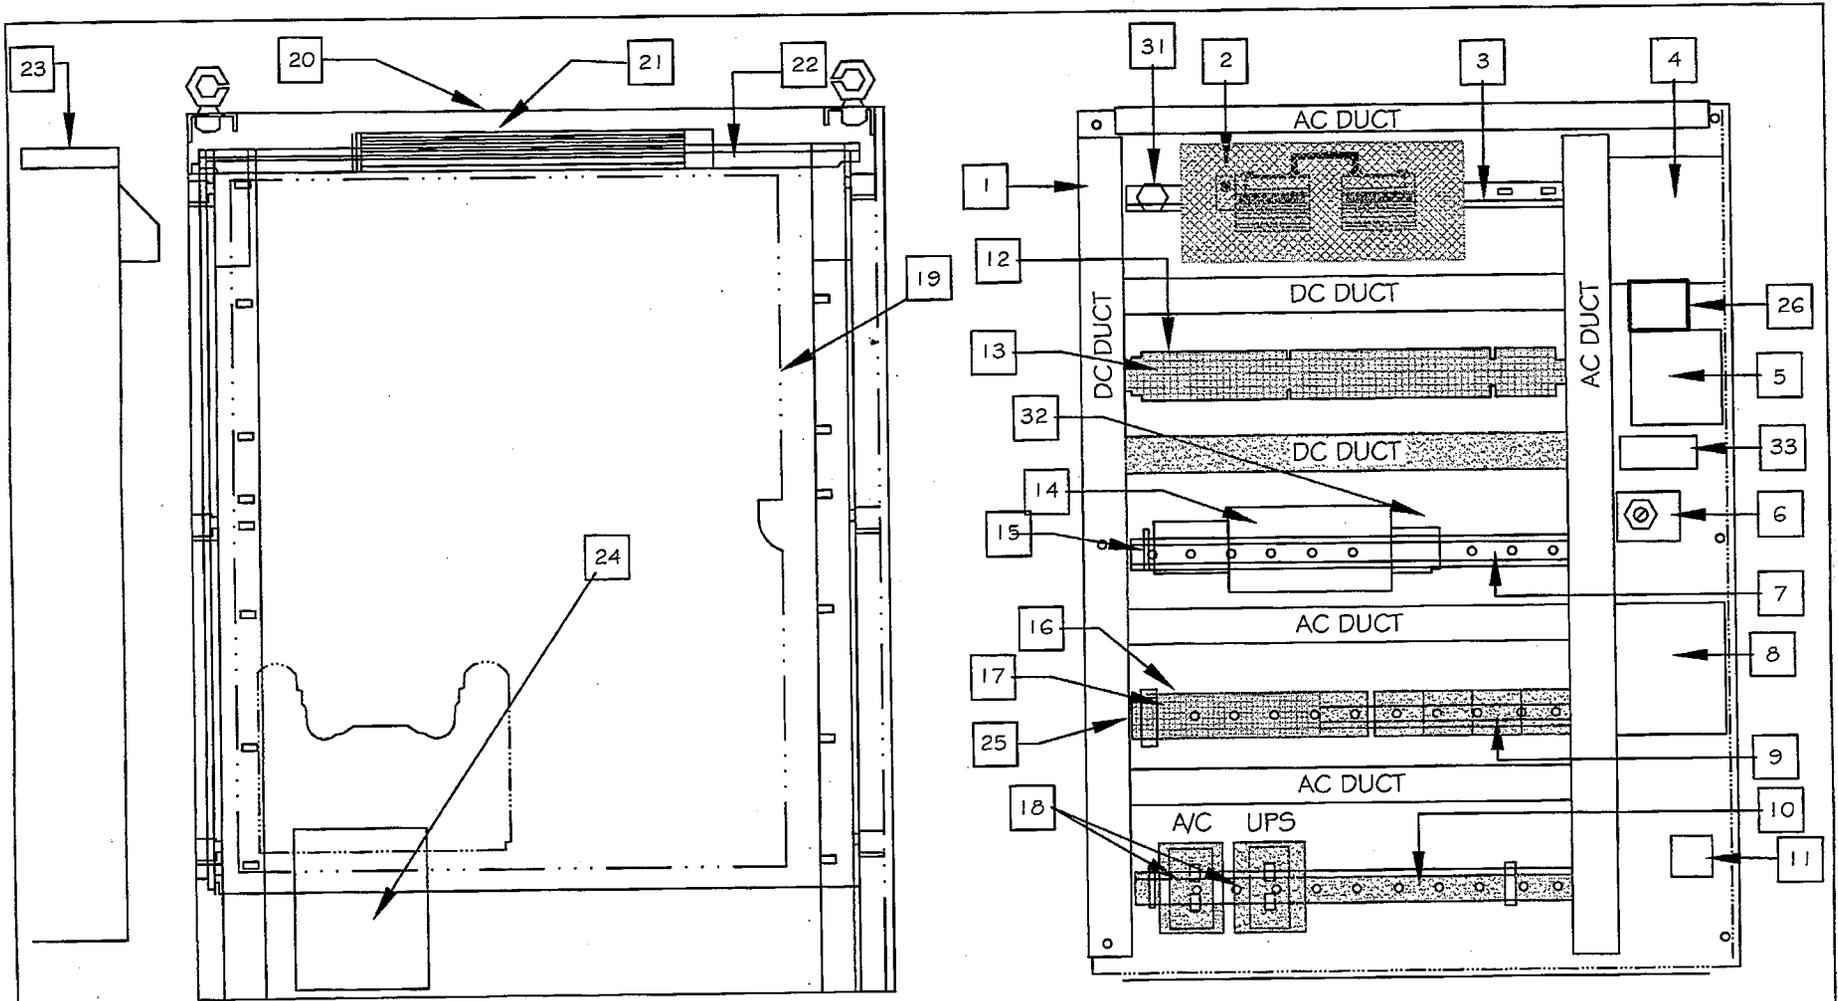

SEE SCADA MATERIAL LIST
PAGES 9 - 10

AC WIRING - RED COLORING HOT
 AC WIRING - GREEN COLORING EARTH GROUND
 DC WIRING - BLUE COLORING +
 ANALOG WIRING - CABLE SHIELDED

AC WIRING - WHITE COLORING COMMON
 DC WIRING - WHITE/BLUE COLORING -
 AC & DC NOT IN SAME RACEWAY

DETAIL NO.
C- 405
 NTS



CITY OF
 CHANDLER
 STANDARD
 DETAIL

SCADA CABINET

APPROVED: *[Signature]*
 CITY ENGINEER

DATE: *01/08/09*

DETAIL NO.
C- 405
 PAGE 8 OF 12

ITEM	DESCRIPTION	MFG	CATALOG	QTY
1	PLASTIC WIRE DUCT	PANDUIT		
2	DIGITAL I/G INPUT/I/G OUTPUT BASE	MODICON Summit 602-267-1000	MODEL 170 ADM35010	1
2	I/O BUS ADAPTER	MODICON	MODEL 170 INT 11000	1
2	ANALOG INPUT BASE	MODICON	Model 170AA11400	1
2	PROCESSOR WITH INTERBUS PORT	MODICON	Model 171CC576000	1
2	PROCESSOR OPTION ADATOR (REDUNDANT MB+)CLOCK	MODICON	Model 172PNN26022	1
2	I/O BUS ADAPTER CABLE	MODICON		1
3	STANDARD DIN RAIL 35 MM X 7.5 MM	ALLEN BRADLEY	199-DR1	1
4	MAG FLOWMETER CONVERTER PANEL MOUNT 120 VAC, 4-20 MA, HART, LCD DISPLAY FOR <16 INCH DETECTORMAG FLOW TUBE SEPARATE ELECTRONICS	Cadillac-AXIOM SOUTHWEST 480-814-7706	CMCRUXXTFM 2AS Length in feet 3AE Length in ft	1
5	PROTOCOL CONVERTER HART TO MODBUS RTU W/CONFIGURATION SOFTWARE	ARCOM 1-913-549-1000	HT-D5-1	1
6	SELECTOR SW--3 POS MAINT, NEMA 4/13 30.5 MM, KNOB 1NO-1NC SCREW TERMINALS	SQUARE D	9001KS43BH13	1
7, 10, 12 & 25	RAISED DIN RAIL 35 MM X 7.5 MM	ALLEN BRADLEY BORDER 602-244-0331	1492-DR6	4
8	RADIO TRANSCEIVER LICENSED 800 TO 960 MHZ, 5 WATTS, -30 DEG C TO + 60 DEG C	MDS Radio Border States Electric 602-244-0331	9710A	1
9	LEVEL RELAY PLUG-IN DRDT, 10KOHM, 120 VAC, 10 SEC W/ BASE	WARRICK	16DMB1AO-X-10-10	2
9	RELAY--ICE CUBE ICE CUBE 24 VDC COIL DPDT, 10 A CONTACTS W/NR51 BASE	SQUARE D	8591KP12V14	2
9	RELAY--ICE CUBE ICE CUBE 120 VAC COIL DPDT, 10 A CONTACTS W/NR51 BASE	SQUARE D	8501KP12V20	1
11	LIGHTNING PROTECTOR FLANGE MOUNT 1225-1000MHZ, F/F 220 P J	POLYPHASER	IS-50NX-C2	1
13 & 16	TERMINAL BLOCK DOUBLE FEED--THROUGH BLUE, 24-12 AWG 32 A .25 INCH	PHOENIX CONTACT	UDK 4 BU	74
14	POWER SUPPLY TRACK MOUNTED 24VDC, 240W, 10A W/INTERNAL FUSING	IDEC	PSR5-G24	1
15	POWER SUPPLY TRACK MOUNTED 12VDC, 30W, 2.5A W/INTERNAL FUSING	IDEC	PSR5-C12	1
17	TERMINAL BLOCK DOUBLE FEED--THROUGH GRAY, 24-12 AWG 32 A .25 INCH	PHOENIX CONTACT	UDK 4	26
18	DUPLEX RECEPTACLE TRACK MOUNTED 120V, 15A	PHOENIX CONTACT	EM-DUO/120/15	2
19	BACKPANEL, PAINTED STEEL FOR FS ENCLOSURE	HOFFMAN BrownWholeSale 602-275-8521	AG0P3GF1	1
20	ENCLOSURE, FREE STANDING, NEMA 12, PAINTED STEEL	HOFFMAN	AG03G24FS	1
21	LIGHTING PACKAGE, FLUORESCENT, 115 VAC .63 AMPS PROVIDE BULBS (NOT IN PACKAGE)	HOFFMAN	A-LFM1GD18	1
22	DRIP SHIELD FOR NEMA 12, 4 NEMA 3R, 36 IN WIDE	HOFFMAN	ADK36A	1
23	AIR CONDITIONER SIDE PANEL MOUNT 115 VAC, 4000 BTU	HOFFMAN	M33-0416-G010	1
24	UPS PRO LINE 850 VA FOR 9 MINUTES 26 MINUTES AT HALF POWER	TRIPPLITE	BCPRO850	1
26	ELECTRONIC VALVE CONTROLLER AND SIGNAL RETRANSMISSION MODULES	CLA-VAL ESCO Phone # (602) 264-7946	131VC-1	1
27	10" PIPE DIAMETER WITH HEAVIER SPRING ELECTRIC VALVE	CLA-VAL ESCO Phone # (602) 264-7946	131G-37BY	1
28	LEVEL PROBE WIRE SUSPENDED STAINLESS STEEL W/PVC COATED WIRE	WARRICK	3W1	3

DETAIL NO.

C-405

NTS



CITY OF
CHANDLER
STANDARD
DETAIL

MATERIALS LIST 1 OF 2

APPROVED:

[Signature]

CITY ENGINEER

DATE:

01/08/09

DETAIL NO.

C-405

PAGE 9 OF 12

ITEM	DESCRIPTION	MFG	CATALOG	QTY
29	PROBE FITTING, PIPE MOUNT, 2 IN , 3 PROBE, BRASS	WARRICK	3E-3B	1
30	LOW PROFILE PEDESTALS	TESCO #(916) 395-8800	26-000 typellIAF	1
31	TYPE T THERMOCOUPLE XMTR MINATURE SCALED 0 - 250 DEG F	AXIOM	AXT251-T-O-250F	1
32	1 POLE CIRCUIT BREAKER MINIATURE TRACK MOUNTED 16 A, B (FAST) CURVE MERLIN GERIN	SQUARE D	MG24118	1
33	LCD DISPLAY SCALEABLE FOR ENG UNITS INCHES AND FEET	AXIOM SOUTHWEST 480-814-7706	AXG85	
34	WELL LEVEL TRANSDUCER .1% ACCURACY, HART DIGITAL PROTOCOL, RANGE 16.7' SPAN,CABLE LENGTH 20' WITH REMOTE DISPLAY	AXIOM SOUTHWEST 480-814-7706	CWLTY-0303-26-26 W-05-RNG16.7ft-02- 1907-LEN20ft/CWD50 -0325-2603	1
35	MAGMETER CADILLAC MAG FLOW TUBE 10", ANSI 150LB, 316SS, RUBBER	Cadillac-AXIOM SOUTHWEST 480-814-7706	Model CMAGIRCF150SD5FM	1
36	GAUGE MODEL 30 INWC/O/+100PSI	AXIOM SOUTHWEST 480-814-7706	Ax9831741-4	1
37	AIR RELIEF/VACUUM CHECK 2"	GOBLE SAMPSON 480-969-3667	MODEL# 144DAT.1-F2-1G/57	1
38	PRESSURE TRANSMITTER WITH LOCAL DISPLAY TX -15 TO +285 PSI, CONFIGURATION, HART COMPATIBLE, 1/2" CONNECTION, LOOP POWERED 4 - 20 MA OUTPUT.	AXIOM SOUTHWEST 480-814-7706	CPLVY-0303-0213-Z- RNG(-15to+285psig)- 02-1916-1326-22	1
39	BRASS CALIBRATION PORT, 1/4" WITH CHECK AND CAP	RALSTON INDUSTRIES (800) 347-6575	#QFTT 2MBI	1
	COAXIAL CABLE --HELIAX 7/8 INCH W/CONNECTORS	ANDREW	LDF5-50	2
	MULTI-CONDUCTOR CABLE--BRAID SHIELDED CONTROL CABLE--18AWG--2 CONDUCTOR (19 X 30) 600V. -65 TO 200 DEG C	BELDEN	83321	9
	CABLE ASSEMBLY--CUSTOM--22AWG	GENERIC	RS323C	1
	RESISTOR 250 OHM, 1 WATT	GENERIC	RE5-250	1
	PLUG NEMA 5-15P, 15A, 125 VAC	HUBBEL	HBL5266C	2
	BARE THERMOCOUPLE TYPE T 20 GA. 12" LONG PLUS 3" LEADS	OMEGA	BARE-20-T-12	1
	ANTENNA YAGI 890-960 MHZ W/ MOUNTING HARDWARE	SCALA	TY-900	1
	PANEL SUPPORT, STEEL	HOFFMAN	AG0F5HDPS	1
	END BRACKET UNIVERSAL FOR 2 OR 3 LEVEL GRAY	PHOENIX CONTACT	EUK 1	8
	FUSE TERMINAL BLOCK WITH SCREW CAP TRACK MOUNTED 250 VAC, 20 A FOR BUSSMAN GMC GLASS FUSES	PHOENIX CONTACT	UK 10-DREH5LA 250 (5 X 20)	4
	FUSE, GLASS 5 MM X 20 MM 250 VAC 3.15 AMP MEDIUM TIME DELAY	BUSSMAN	GMC 3.15A	
	END COVER UNIVERSAL GRAY	PHOENIX CONTACT	D-UDK 4	6
	TERMINAL BLOCK DOUBLE FEED--THROUGH GRN-YLW, 24-12 AWG, 32A GROUND TO RAIL .25 INCH	PHOENIX CONTACT	UDK 4-PE	8
	NAMEPLATE ENGRAVED PLASTIC BLACK W/ WHITE LETTERING 1 X 0.25 INCH, TEXT .1 IN TALL	GENERIC	NPGN1X.25OLT	24
	NAMEPLATE ENGRAVED PLASTIC BLACK W/ WHITE LETTERING 3 X 1 INCH, TEXT .1 & .2 IN TALL	GENERIC	NPGN312LT	2
	NAMEPLATE ENGRAVED PLASTIC BLACK W/ WHITE LETTERING 3 X 1 INCH, TEXT .1, .2, & .15 IN TALL	GENERIC	NPGN312L3PT	1
	NAMEPLATE ENGRAVED PLASTIC BLACK W/ WHITE LETTERING 3 X 1 INCH, TEXT .5 IN TALL	GENERIC	NPGN311L	1
	CUSTOM BRACKET PAINTED STEEL 18 GA DIMENSIONS AS SHOWN	GENERIC	BRKT-1	1
	METAL LEGS TO RAISE PANEL A MINIMUM OF 12" --MAXIMUM 24" ABOVE THE PAD	HOFFMAN	SEE OPTION	1 set

DETAIL NO.

C-405

NTS

CITY OF
CHANDLER
STANDARD
DETAIL**MATERIALS LIST 2 OF 2**

APPROVED:

CITY ENGINEER





DATE:

01/08/09

DETAIL NO.

C-405

PAGE 10 OF 12

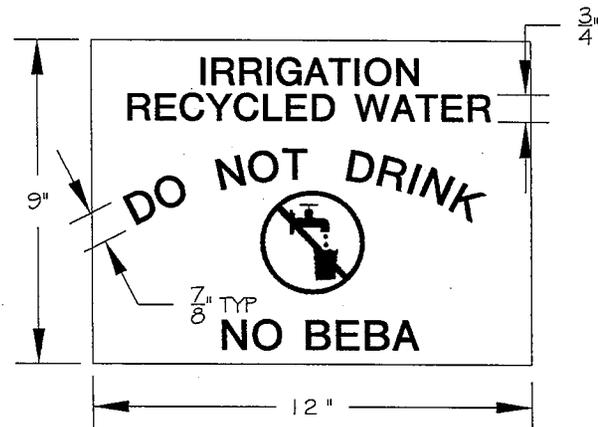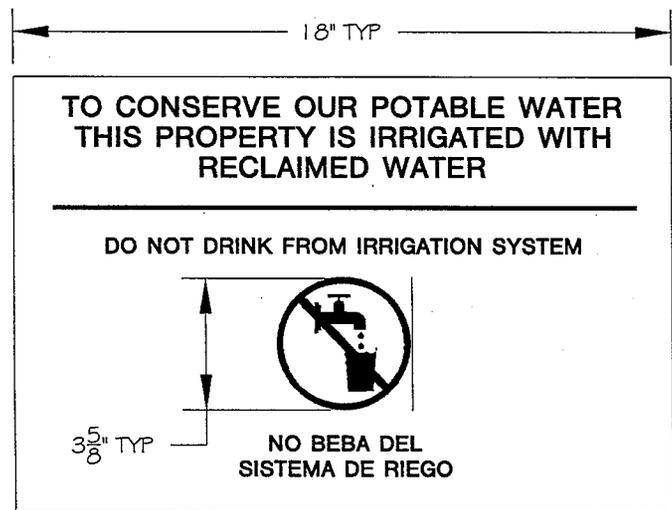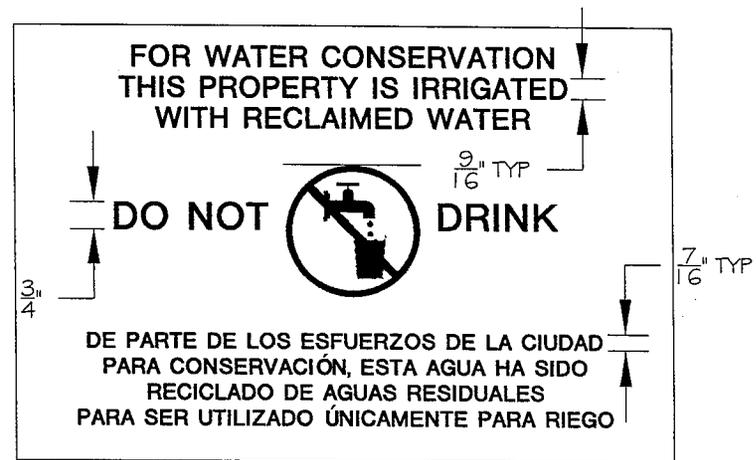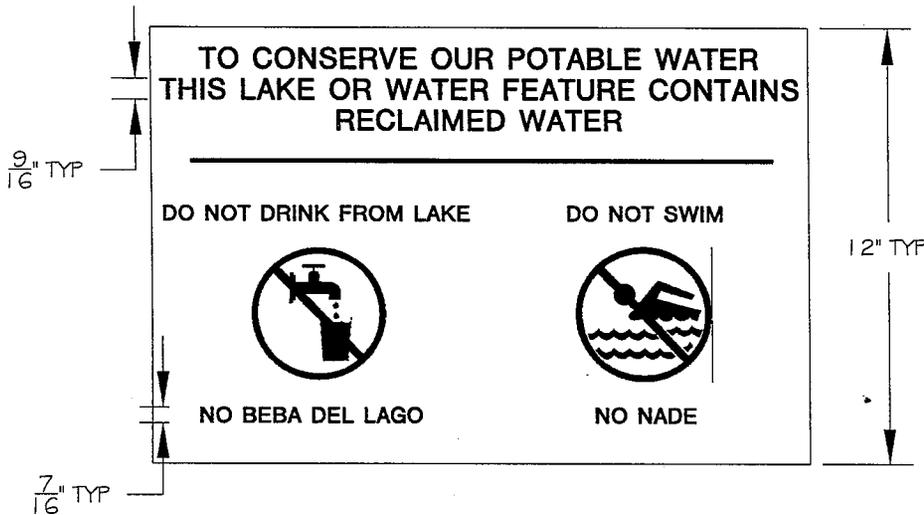

NOTES:

- COLOR: COPY: WHITE
- BACKGROUND: PURPLE (PANTONE 512)
- SIGN PANEL: 1/8" ALUMINUM ALLOY 5052-H38 PER ASTM B 209
- PROVIDE 3/8" BORDER BETWEEN PANEL AND BACKGROUND

DETAIL NO.
C-405
NTS



CITY OF
CHANDLER
STANDARD
DETAIL

SIGNAGE

APPROVED: *[Signature]* FOR
CITY ENGINEER
DATE: 11-30-09

DETAIL NO.
C-405
PAGE II OF 12

ALL EQUIPMENT FURNISHED SHALL BE NEW AND OF CURRENT DESIGN. LIKE EQUIPMENT SHALL BE OF SAME MANUFACTURER.

THE CONTRACTOR SHALL PURCHASE LABOR, MATERIALS, APPARATUS, APPLIANCES, AND INSTRUMENTATION FROM LOCAL ARIZONA-BASED, AUTHORIZED, FACTORY-TRAINED ENGINEERING REPRESENTATIVES, NOT JUST A STOCKING DISTRIBUTOR. THEY SHALL BE LOCATED WITHIN A 100-MILE RADIUS OF THE PROJECT AND HAVE BEEN IN THE VICINITY FOR A MINIMUM OF 5 YEARS.

DESCRIPTIVE DATA: SUBMIT COPIES OF COMPLETE DESCRIPTIVE LITERATURE, PERFORMANCE DATA, PHYSICAL DIMENSIONS, POWER AND SIGNAL CONNECTIONS FOR EACH COMPONENT AND EQUIPMENT TO BE FURNISHED. PROVIDE NAME OF MANUFACTURER, STYLE, AND COMPLETE MODEL NUMBER. LISTING ITEMS "AS SPECIFIED" WITHOUT BOTH MAKE AND MODEL OR TYPE DESIGNATION IS NOT ACCEPTABLE. SUBSTITUTIONS SHALL NOT BE ALLOWED WITHOUT PRIOR APPROVAL.

COMPONENT DATA SHEETS: SUBMIT A COMPONENT DATA SHEET FOR EACH PIECE OF INSTRUMENTATION EQUIPMENT SIMILAR TO AN ISA 520 FORM. INCLUDE EQUIPMENT TAG NUMBER, MANUFACTURER'S MODEL NUMBER, LOCATION OF SERVICE, MATERIALS OF CONSTRUCTION, SIZE AND SCALE RANGE, CALIBRATED RANGE, SET POINTS, OPTIONAL ACCESSORIES AND ANY OTHER USEFUL INFORMATION.

CONTROL SYSTEM DRAWINGS: SUBMIT 11" X 17" DETAILED SHOP DRAWINGS INDICATING DIMENSIONS, COMPONENT LAYOUT, MOUNTING DETAILS, WIRING DIAGRAMS, NAMEPLATE LEGENDS AND BILL OF MATERIALS FOR EACH CONTROL PANEL.

WIRING DIAGRAMS SHALL INCLUDE ALL INTERCONNECTIONS, INTER-WIRING AND TERMINALS BETWEEN ALL ELECTRICAL AND/OR INSTRUMENTATION UNITS. WIRE NUMBERS SHALL BE CONTINUOUS FROM START TO FINISH. WIRE NUMBERS SHALL NOT CHANGE WHEN GOING FROM ONE UNIT, CABINET, ENCLOSURE, TERMINAL OR ANY DEVICE TO ANOTHER.

THE SPECIFICATIONS REFERENCE KNOWN STANDARDS AND CODES. EACH SUCH STANDARD REFERENCED SHALL BE CONSIDERED A PART OF THE SPECIFICATIONS TO THE SAME EXTENT AS IF REPRODUCED THEREIN IN FULL. THE FOLLOWING IS A REPRESENTATIVE LIST OF SUCH ASSOCIATIONS, INSTITUTES AND SOCIETIES, TOGETHER WITH THE ACRONYM BY WHICH EACH IS IDENTIFIED:

AIEE	AMERICAN INSTITUTE OF ELECTRICAL ENGINEERS	NEC	NATIONAL ELECTRICAL CODE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE	NEMA	NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS	NETA	NATIONAL ELECTRICAL TESTING ASSOCIATION
ICEA	INSULATED CABLE ENGINEERS ASSOCIATION	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
IEEE	INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS	UL	UNDERWRITER'S LABORATORIES, INC.

EVERY REFERENCE IN THE SPECIFICATIONS SHALL MEAN THE LATEST PRINTED EDITION OF EACH IN EFFECT AT THE CONTRACT DATE OR LATEST EDITION AS ADOPTED BY THE LOCAL GOVERNING AUTHORITY.


SYSTEM RESPONSIBILITY INCLUDES BUT IS NOT NECESSARILY LIMITED TO FURNISHING SYSTEM COMPONENTS, SYSTEM INTEGRATION AND DESIGN, WIRING DIAGRAMS, INSTALLATION SUPERVISION, FIELD INSTRUMENT CALIBRATION, STARTUP, TESTING AND OPERATOR TRAINING. THE I&C CONTRACTOR SHALL COORDINATE WITH THE CITY AND THE PROGRAMMER FOR IMPLEMENTING AND TESTING THE PLC PROGRAMS PRIOR TO THE RTU DELIVERY TO THE SITE.

THE I&C CONTRACTOR SHALL BE A REPUTABLE SYSTEM INTEGRATOR AND BE AN UNDERWRITERS LABORATORY (UL) 508A RECOGNIZED PANEL FABRICATOR. THE I & C CONTRACTOR AND PROGRAMMER MUST BE SEPARATE SUBCONTRACTORS TO THE ELECTRICAL CONTRACTOR. THE I&C CONTRACTOR AND THE ELECTRICAL CONTRACTOR SHALL BE LOCATED WITHIN A 100-MILE RADIUS OF THE PROJECT AND HAVE BEEN IN THAT VICINITY FOR A MINIMUM OF FIVE (5) YEARS. THE I&C CONTRACTOR AND THE ELECTRICAL CONTRACTOR CANNOT BE ONE AND THE SAME.

PROGRAMMER SHALL PROVIDE FULL DOCUMENTATION--BOTH PAPER DOCUMENT OF PROCESS DESCRIPTIONS WITH PAGE NUMBERS AND INDEX AND IN-SOFTWARE NETWORKS, CONTACTS, COILS, AND REGISTERS WITH DESCRIPTIONS AT ALL POINTS. THE PROGRAMMING LANGUAGE SHALL BE PROWORX NXT.

THE TURNOUT STRUCTURE MUST BE CAPABLE OF RECEIVING A MINIMUM OF 2,000 GPM THROUGH THE RECEIVING BOX BELOW THE AIR GAP WITHOUT OVERFLOWING.

DETAIL NO. C-405 NTS	 CITY OF CHANDLER STANDARD DETAIL	GENERAL NOTES	APPROVED:  CITY ENGINEER DATE: <u>01/08/09</u>	DETAIL NO. C-405 PAGE 12 OF 12
-----------------------------------	--	----------------------	---	---

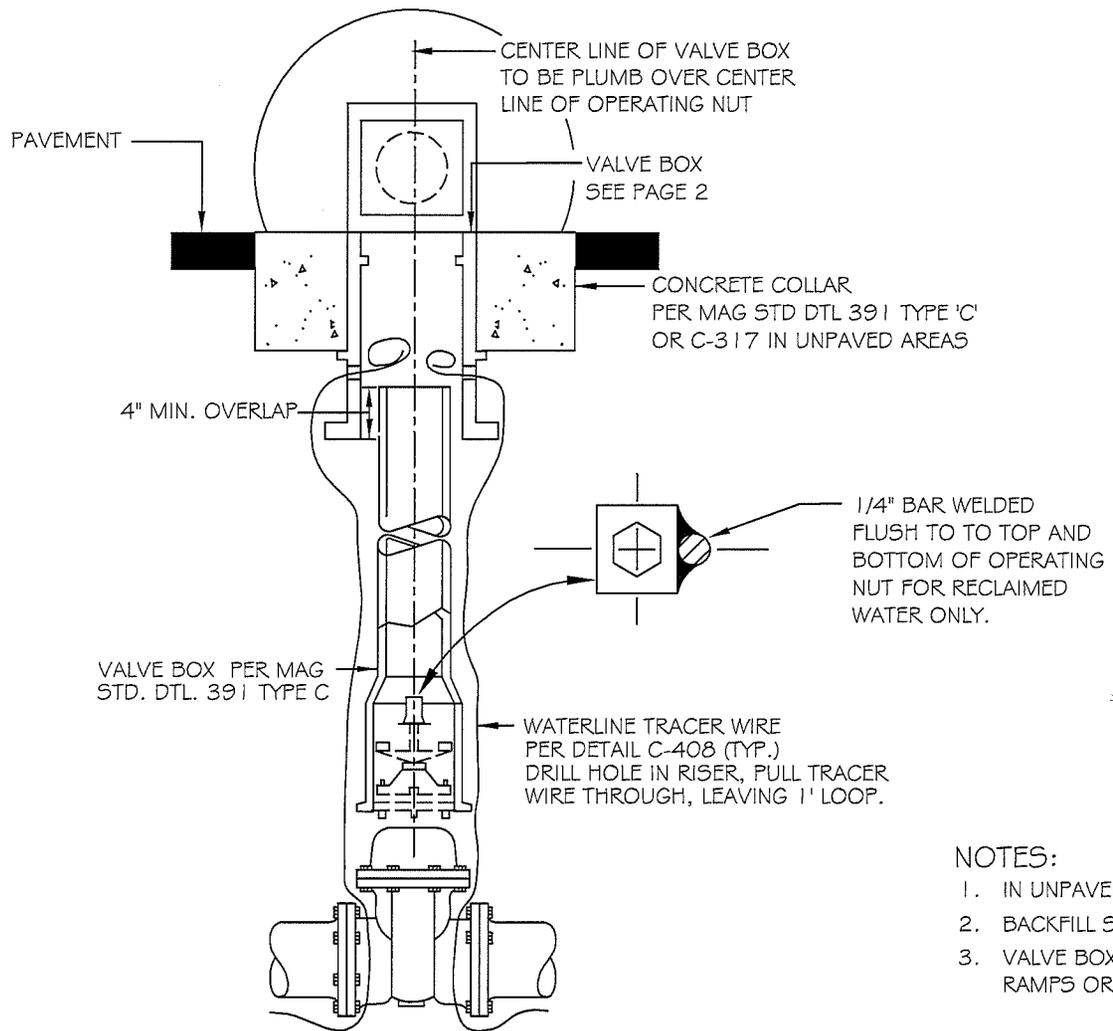

- NOTES:
1. IN UNPAVED AREAS, CONCRETE COLLAR SHALL CONFORM TO DETAIL C-317.
 2. BACKFILL SHALL BE 1/2 SACK CLSM. PER MAG. SPECIFICATION 718.
 3. VALVE BOXES SHALL NOT BE INSTALLED WITHIN CONCRETE GUTTER, SIDEWALK, RAMPS OR VALLEY GUTTER.

DETAIL NO.
C- 406
 PAGE 1 OF 2




CITY OF
 CHANDLER
 STANDARD
 DETAIL


**VALVE BOX INSTALLATION
 (RECLAIMED WATER)**

APPROVED: *[Signature]*
 CITY ENGINEER
 DATE: 07-09-2015


DETAIL NO.
C- 406
 PAGE 1 OF 2

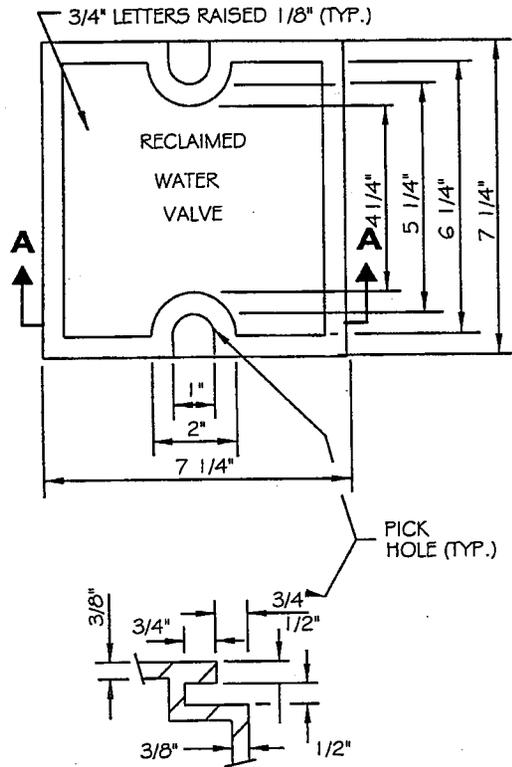

SECTION

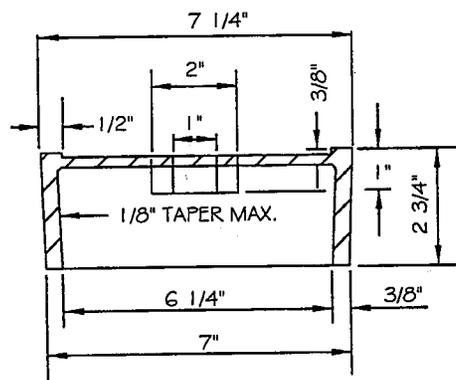

**SECTION A - A
COVER**

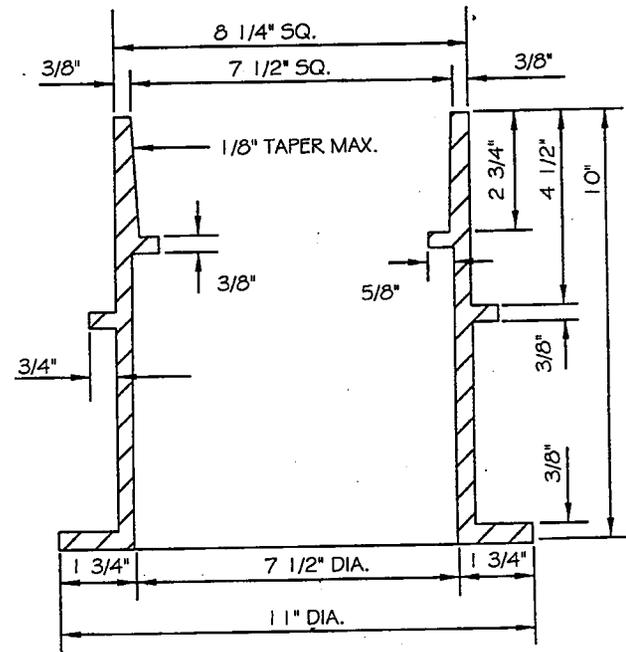

**SECTION
VALVE BOX**

NOTES:

1. ALL MATERIAL SHALL BE CAST IRON PER ASTM. A-48, CLASS 30 B.
2. THE SURFACES OF THE COVER AND BOX WHICH COME IN CONTACT WITH EACH OTHER MUST BE SMOOTH AND FREE OF ALL CASTING RIDGES AND BURRS TO PROVIDE A SNUG FIT.
3. THE VALVE BOX SHALL HAVE A ROUND BOTTOM TO ACCOMMODATE RISER PIPE. THE TOP OF THE VALVE BOX SHALL BE SQUARE.
4. THE LID AND INSIDE AND OUTSIDE OF THE RISER PIPE SHALL BE COLORED PURPLE. COLOR MAY BE INCORPORATED INTO PIPE DURING MANUFACTURE OR PAINTED ONTO PIPE SURFACE. WHEN PAINTED THE PAINT SHALL BE SEYMOUR SAFETY PURPLE.
5. LETTERING SHALL BE RESTRICTED TO THAT SHOWN ON THE VALVE BOX COVER.

DETAIL NO.
C-406



CITY OF
CHANDLER
STANDARD
DETAIL

**VALVE BOX INSTALLATION
(RECLAIMED WATER)**

APPROVED:

Boyd D. Talley
CITY ENGINEER


DATE:

11-19-99

DETAIL NO.

C-406

PAGE 2 OF 2

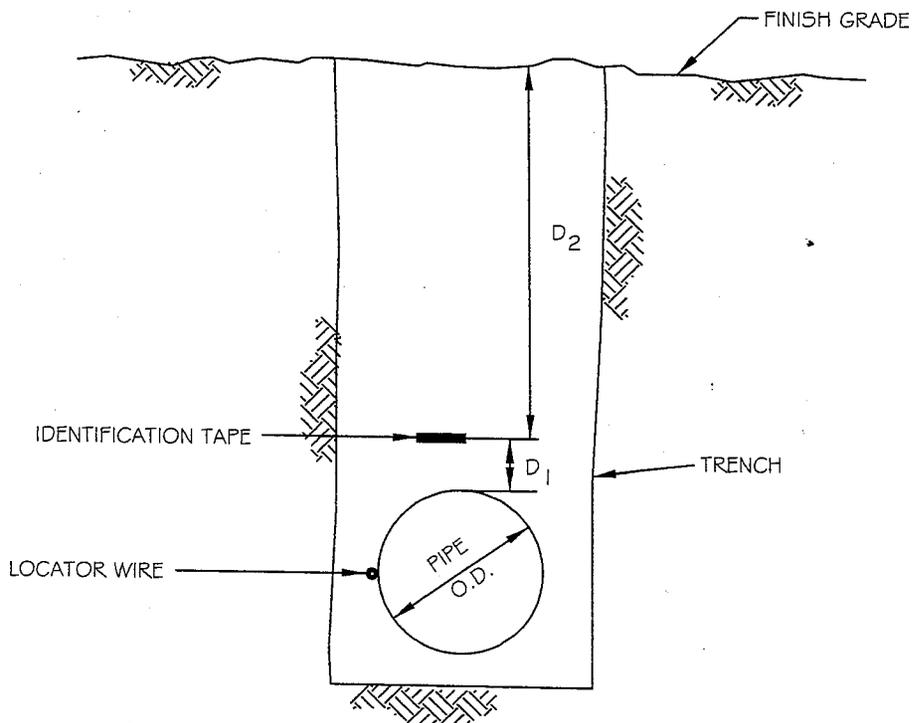

NOTES:

1. I.D. TAPE AND LOCATOR WIRE SHALL BE INSTALLED ON PUBLIC DISTRIBUTION AND COLLECTION MAINS FOR ALL PIPE MATERIALS AND SIZES 4" AND LARGER
2. I.D. TAPE AND MARKINGS SHALL BE PER MAG STD. SPEC. SEC. 616.4, EXCEPT AS MODIFIED HEREON.
3. LOCATOR WIRE SHALL BE 14 GAUGE THWN COPPER WIRE.
4. D_1 SHALL BE 12", HOWEVER, ADJUST D_1 , AS NECESSARY, SO THAT D_1 IS NEVER GREATER THAN 48".
5. LOCATOR WIRE SHALL ORIGINATE/TERMINATE AT VALVE BOXES AND MANHOLES AND BE SECURED TO VALVE BOX OR MANHOLE NO MORE THAN 12" BELOW COVER.
6. LOCATOR WIRE SHALL BE VERIFIED FOR ELECTRICAL CONTINUITY ALONG THE ENTIRE LENGTH.

IDENTIFICATION TAPE COLOR AND MARKING SCHEDULE

PIPELINE USE	COLOR	PRINTED MESSAGE
RECLAIMED WATER	MAG SPEC SEC 616.4	MAG SPEC SEC 616.4
POTABLE WATER	SOLID COLUMBIA BLUE	CAUTION POTABLE WATER LINE
SEWER	GREEN	CAUTION: SANITARY SEWER

C-408



CITY OF
CHANDLER
STANDARD
DETAIL


PIPE LOCATOR WIRE & I.D. TAPE

APPROVED: *Kevin Huls*
CITY ENGINEER
DATE: 01-27-11


DETAIL NO.

C-408

NTS

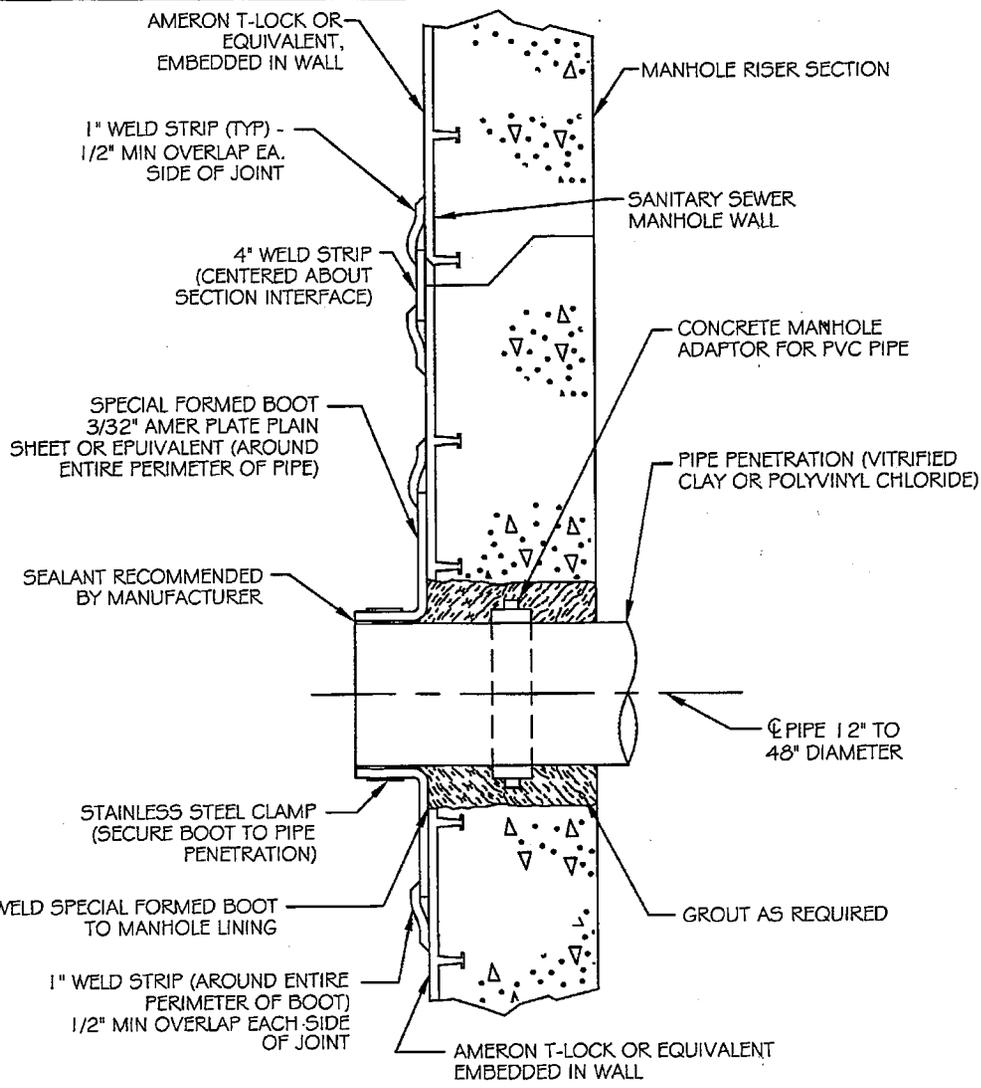

PIPE PENETRATION DETAIL


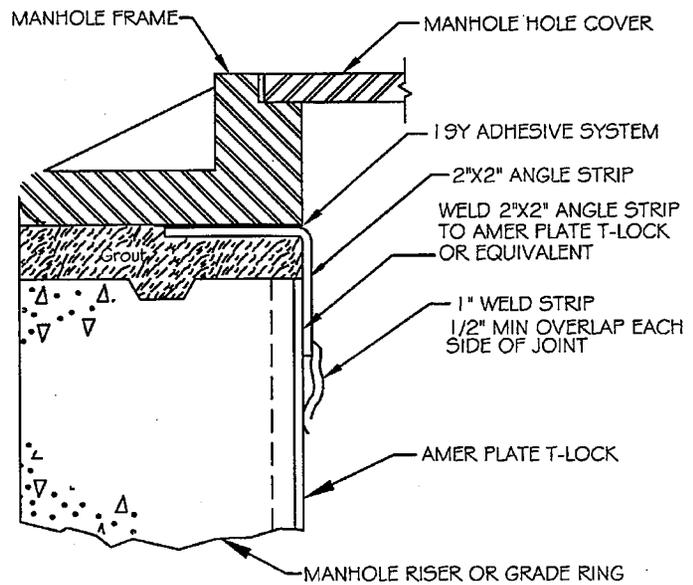


NOTE:
2" X 2" ANGLE STRIP TO BE ATTACHED TO MANHOLE FRAME USING 19Y ADHESIVE PRIOR TO SETTING FRAME.

MANHOLE FRAME TERMINATION DETAIL

NOTE:
ALL FIELD JOINTS FOR T-LOCK LINED MANHOLE SECTIONS SHALL BE TYPE P-1 JOINTS WITH 4" WELD STRIP WITH 2-1" WELD STRIPS SECURING THE JOINT STRIP IN PLACE.

DETAIL NO. C-409 NTS	 CITY OF CHANDLER STANDARD DETAIL	PIPE PENETRATION AND MANHOLE FRAME TERMINATION DETAIL	APPROVED: <i>Jain Hyl</i> CITY ENGINEER DATE: <i>01/09/09</i>	DETAIL NO. C-409 NTS
-----------------------------------	---	---	---	-----------------------------------

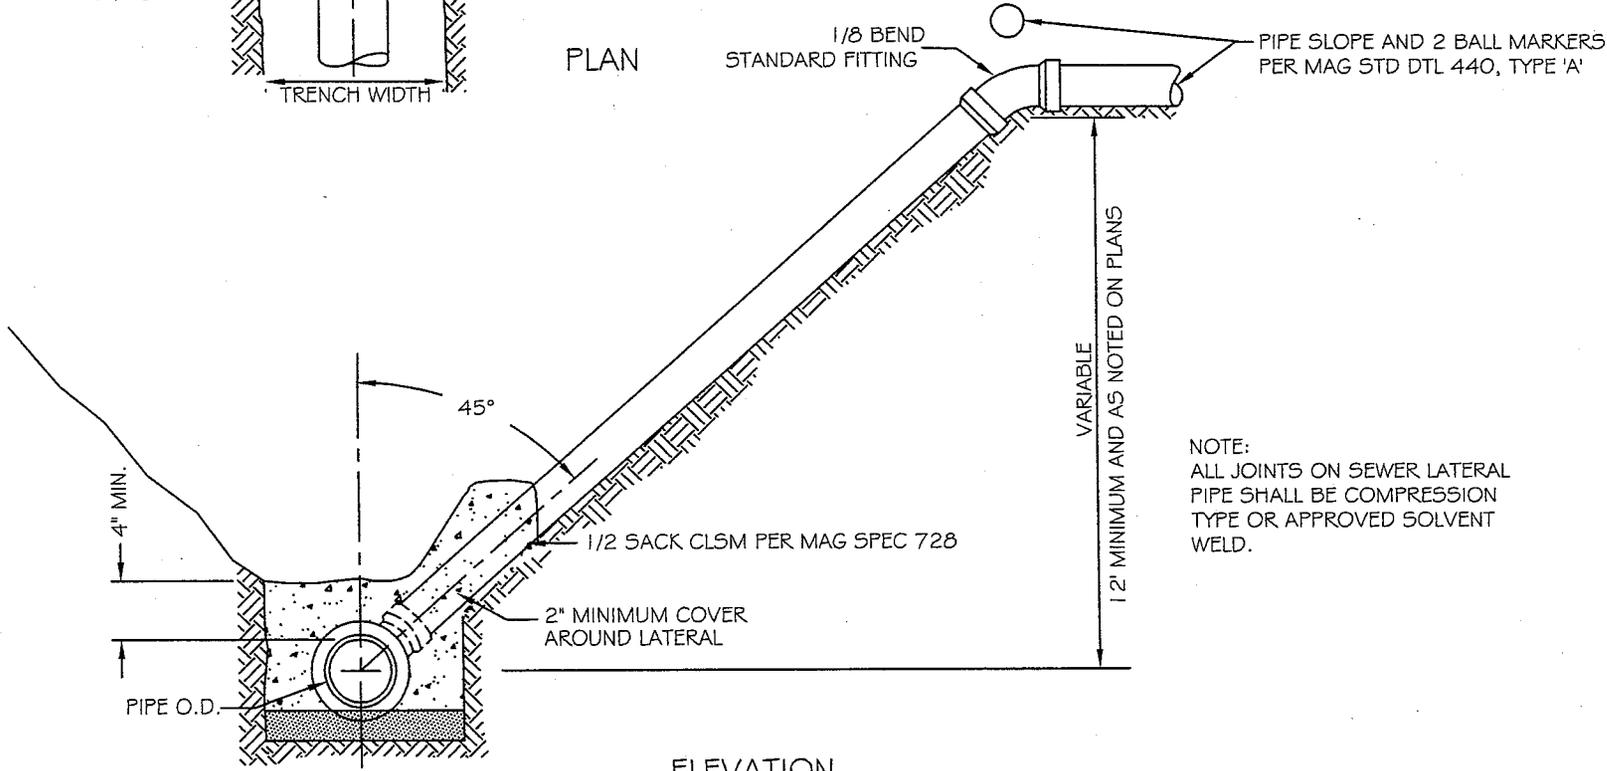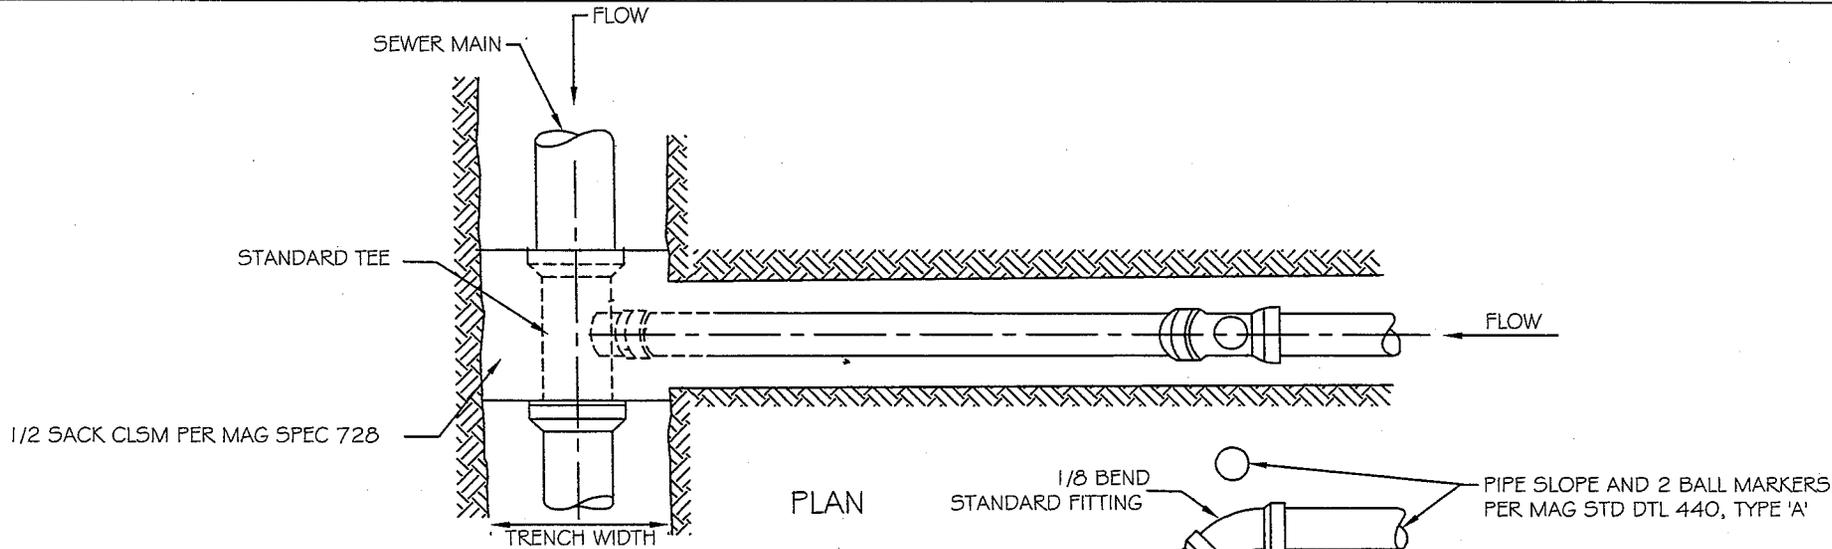

NOTE:
 ALL JOINTS ON SEWER LATERAL
 PIPE SHALL BE COMPRESSION
 TYPE OR APPROVED SOLVENT
 WELD.

DETAIL NO.
C-410
 NTS




CITY OF
 CHANDLER
 STANDARD
 DETAIL

**DEEP CUT SEWER CONNECTION
 (SEWER LATERAL)**


APPROVED: *[Signature]*
 CITY ENGINEER
 DATE: 01/14/10


DETAIL NO.
C-410
 NTS

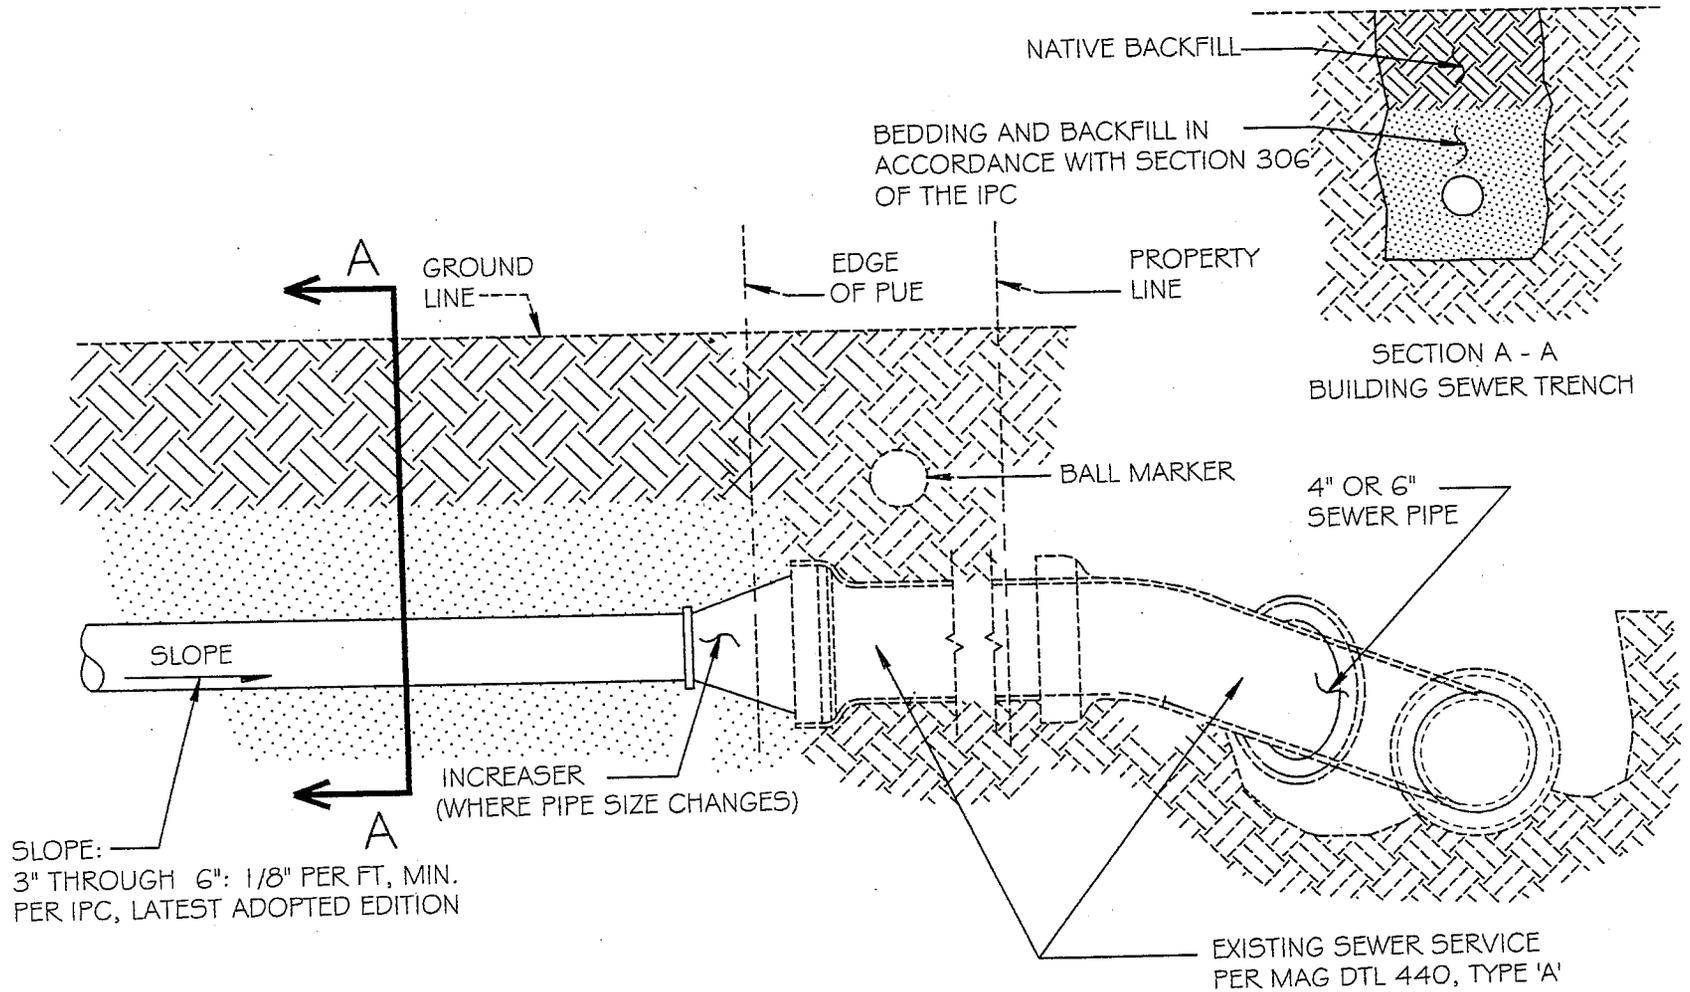

NOTES:

1. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE INTERNATIONAL PLUMBING CODE (IPC), LATEST ADOPTED EDITION.
2. NO PIPE SHALL BE BACKFILLED UNTIL THE LINE HAS BEEN INSPECTED AND APPROVED BY THE DEVELOPMENT INSPECTOR.

DETAIL NO. C-411 NTS	 CITY OF CHANDLER STANDARD DETAIL	BUILDING SEWER CONNECTION	APPROVED:  CITY ENGINEER DATE: 01/14/10	DETAIL NO. C-411 NTS
-----------------------------------	---	----------------------------------	--	-----------------------------------

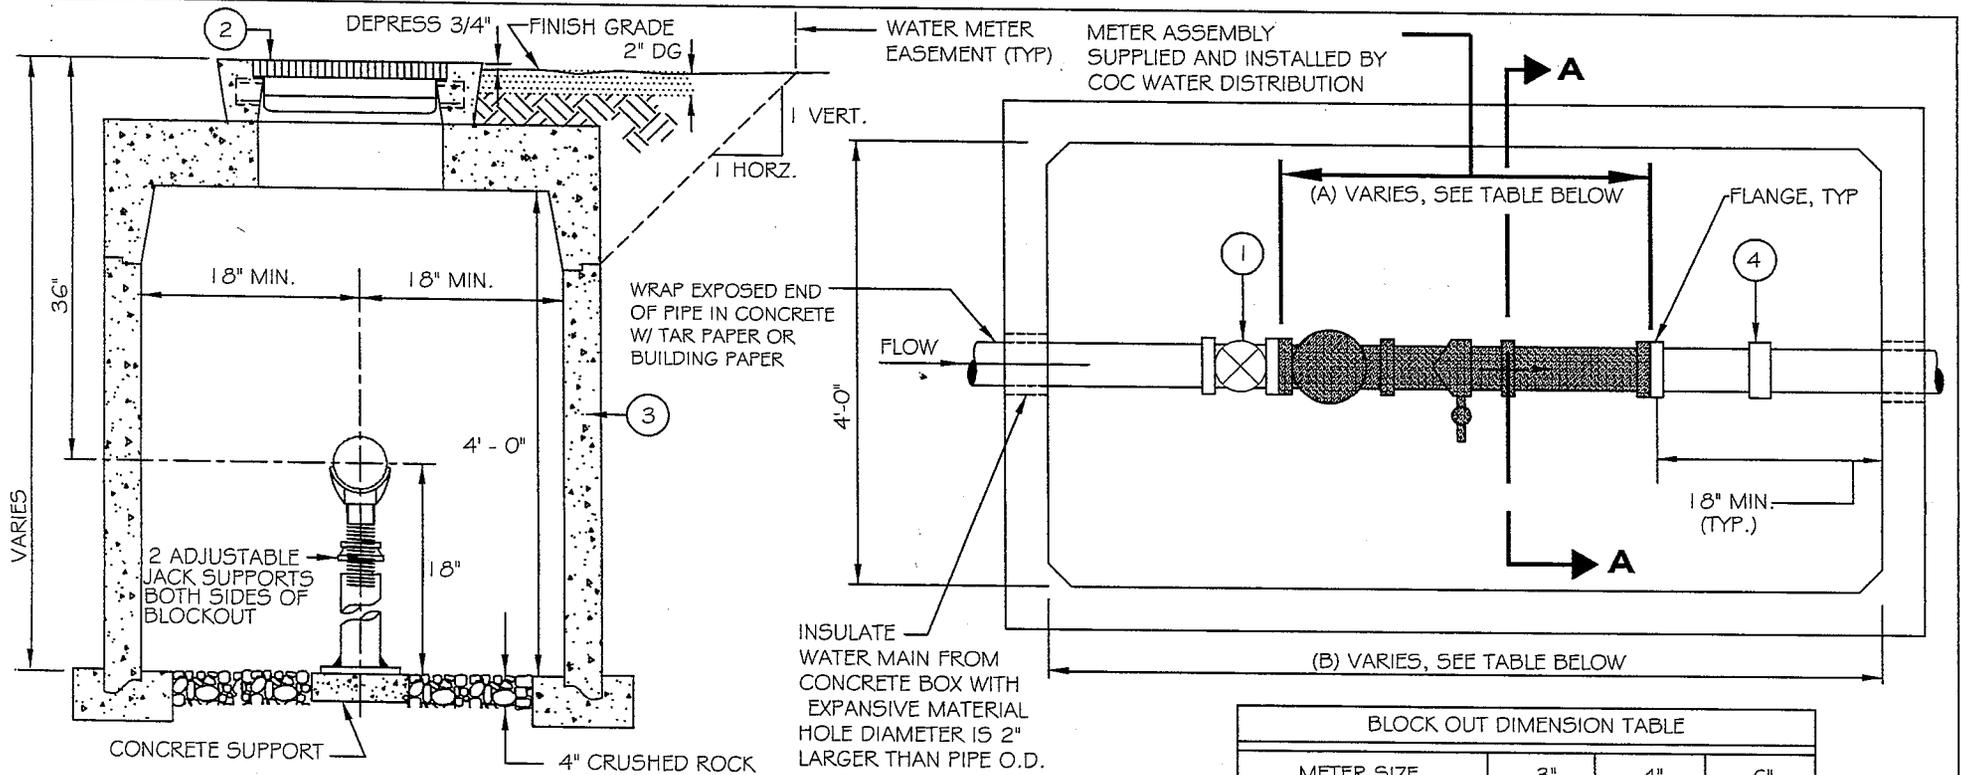


SECTION A-A

BLOCK OUT DIMENSION TABLE			
METER SIZE	3"	4"	6"
METER ASSEMBLY (A) BLOCK OUT	1'- 6-3/4"	1'- 10-1/4"	2'- 3-3/4"
VAULT LENGTH (B)	4' - 8"	5' - 0"	5' - 6"


- NOTES:**
1. METER VAULTS MAY BE EITHER CAST-IN-PLACE OR PRE-CAST CONCRETE. SEE MAG STANDARD DETAIL 321 FOR VAULT CONSTRUCTION.
 2. STAINLESS BOLTS AND NUTS REQUIRED FOR ENTIRE ASSEMBLY.
 3. PIPE MAIN SHALL BE FULLY RESTRAINED BEYOND INLET AND OUTLET OF VAULT.
 4. CONTRACTOR SHALL PROVIDE FLANGED SPOOL IN METER ASSEMBLY BLOCK-OUT TO PROVE CORRECT ALIGNMENT. SPOOL MAY BE SALVAGED AFTER METER INSTALLATION.
 5. VAULT LID SHALL NOT BE INSTALLED UNTIL AFTER METER IS INSTALLED BY CITY. CALL (480) 782-3700.
 6. CONTRACTOR SHALL DRILL 1-3/4" DIAMETER HOLE IN CENTER OF HATCH.

- LEGEND:**
1. O.S. # Y. GATE VALVE, FLANGED WITH HAND WHEEL OPEN LEFT, AND RISING STEM.
 2. METER HATCH PER SYRACUSE CASTINGS "CH-AL" STYLE PEDESTRIAN RATED ALUMINUM WITH SLAM LOCK OR APPROVED EQUAL. CH-5AL 42" X 42"
 3. METER VAULT PER UTILITY VAULT COC STANDARD DETAIL OR APPROVED EQUAL.
 4. PROVIDE 1" TO 1-1/2" OF PLAY IN THE FLEX COUPLING - CAULDER OR EQUAL.


DETAIL NO. C-416 NTS	 CITY OF CHANDLER STANDARD DETAIL	3" THROUGH 6" RECLAIMED WATER METER VAULT	APPROVED: <i>John Hayes</i> CITY ENGINEER DATE: 01-27-11	DETAIL NO. C-416 NTS
-----------------------------------	---	---	--	-----------------------------------

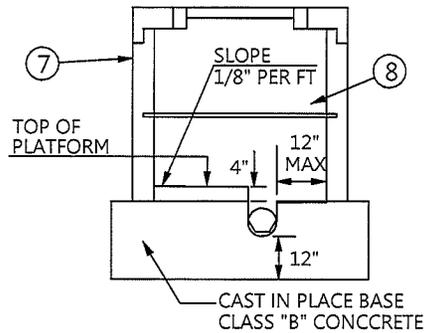

SECTION

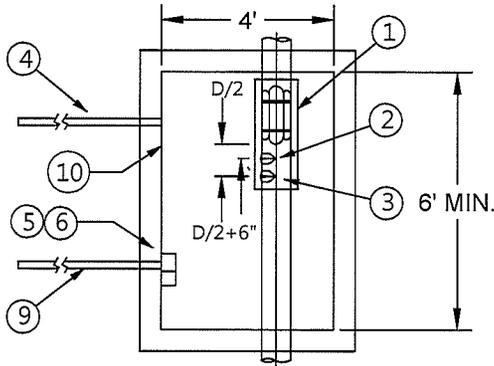

PLAN VIEW WITH COVER REMOVED

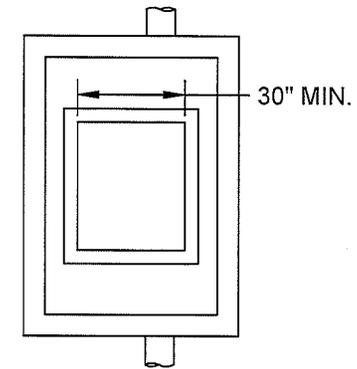

TOP VIEW

CONSTRUCTION NOTES

1. FLUME INSERT (IF REQUIRED).
2. 1/4" 316 SST BUBBLE PIPE IN RECESS.
3. 3/8" 316 SST SAMPLE PIPE IN RECESS.
4. 2" SCH 40 PVC CONDUIT (FOR SAMPLE AND BUBBLE TUBING) WITH THREADED FITTING AND CAP - SEE DETAIL C-417 (PAGE 2) FOR CONTINUATION
5. 120 VAC JUNCTION BOX (EXPLOSION PROOF)-TO BE INSTALLED WITH FLUME.
6. JUNCTION BOX WITH APHENOL CONNECTOR FOR 4-20 MA OUTPUT OR PULSE OUTPUT - TO BE INSTALLED WITH FLUME.
7. PRECAST CONCRETE VAULT AND COVER. ALL VAULTS EXCEEDING HEIGHT OF 5 FEET SHALL BE DESIGNED BY THE APPROPRIATE DESIGN PROFESSIONAL(S).
8. INSTALL 3/4" DIA. 316 SST BAR 24" ABOVE TOP OF PLATFORM AT LOCATION RECOMMENDED BY MANUFACTURER - TO BE WITH FLUME.
9. PROVIDE CONDUIT AND PULL WIRE FOR FUTURE 120 VAC - 30 AMP SERVICE (SEE DETAIL C-417 (PAGE 2) FOR CONTINUATION.
10. INSIDE OF VAULT AND CONCRETE BASE SHALL BE SPRAYED WITH A CITY APPROVED RESIN.

NOTES

1. MINIMUM INSIDE DIMENSIONS OF VAULT SHALL BE 48 INCHES WIDE BY 72 INCHES LONG WITH A MINIMUM HEIGHT OF 42" FROM THE TOP OF THE PLATFORM. ANY MODIFICATIONS TO THESE REQUIREMENTS WILL NEED TO BE REVIEWED AND APPROVED BY COC.
2. ACCESS TO THE VAULT SHALL BE BY A BILCO-STYLE DOOR WITH AN INSIDE OPENING OF AT LEAST 30 INCHES. LOAD SPECIFICATION WILL DEPEND ON INSTALLATION.
3. THE SEWER UPSTREAM OF THE VAULT SHALL BE STRAIGHT FOR LENGTH UPSTREAM OF THE VAULT EQUAL TO AT LEAST 25 PIPE DIAMETERS AND SLOPE OF UPSTREAM SEWER SHALL NOT EXCEED 1%.
4. THE TOP OF THE VAULT SHALL BE BETWEEN 3 AND 12 INCHES ABOVE FINISHED GRADE.
5. THE HEIGHT OF THE VAULT SHALL NOT EXCEED 18 FEET.
6. THE ELECTRICAL JUNCTION BOX REQUIRES A CITY PERMIT BEFORE CONSTRUCTION BEGINS.

DETAIL NO.

C-417

NTS



CITY OF
CHANDLER
STANDARD
DETAIL

**INDUSTRIAL MONITORING VAULT
DETAILS**

APPROVED:


David W. Cook
CITY ENGINEER

DATE: 07-09-2015

DETAIL NO.

C-417

PAGE 1 OF 2

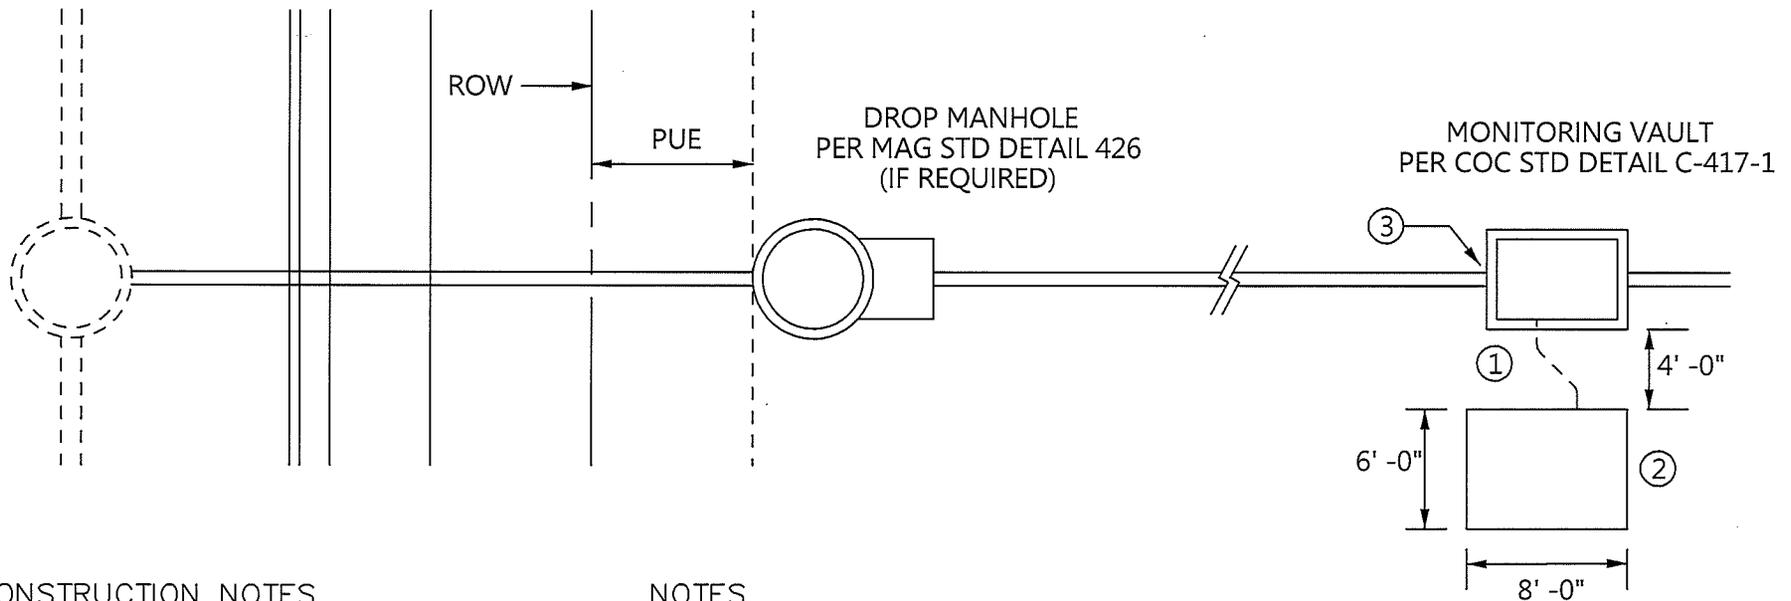

CONSTRUCTION NOTES

1. PROVIDE CONDUIT WITH PULL WIRES FOR FUTURE 120 VAC 30 AMP SERVICE FROM VAULT TO SLAB.
2. PROVIDE 4" THK CONCRETE PAD.
3. PROVIDE MINIMUM OF 1 INCH DROP AT THE DOWNSTREAM END OF THE VAULT.

NOTES

1. PROVIDE CONDUIT AND PULL WIRES TO CONCRETE PAD FOR FUTURE 120 VAC 30 AMP SERVICE.
2. DISTANCE FROM TOP OF VAULT TO TOP OF CONCRETE PLATFORM SHALL BE 5 FT. OR LESS UNLESS OTHERWISE APPROVED BY COC STAFF.
3. COORDINATE SITE PLAN WITH COC PRETREATMENT MONITORING STAFF.
4. TERMINATE ALL CONDUIT WITH AIR TIGHT SERVICE CAPS ABOVE FINISHED GRADE.

DETAIL NO.

C-417

NTS



CITY OF
CHANDLER
STANDARD
DETAIL

**INDUSTRIAL MONITORING VAULT
SITE PLAN**

APPROVED:

David Webb
CITY ENGINEER

DATE:

1-9-14

DETAIL NO.

C-417

PAGE 2 OF 2